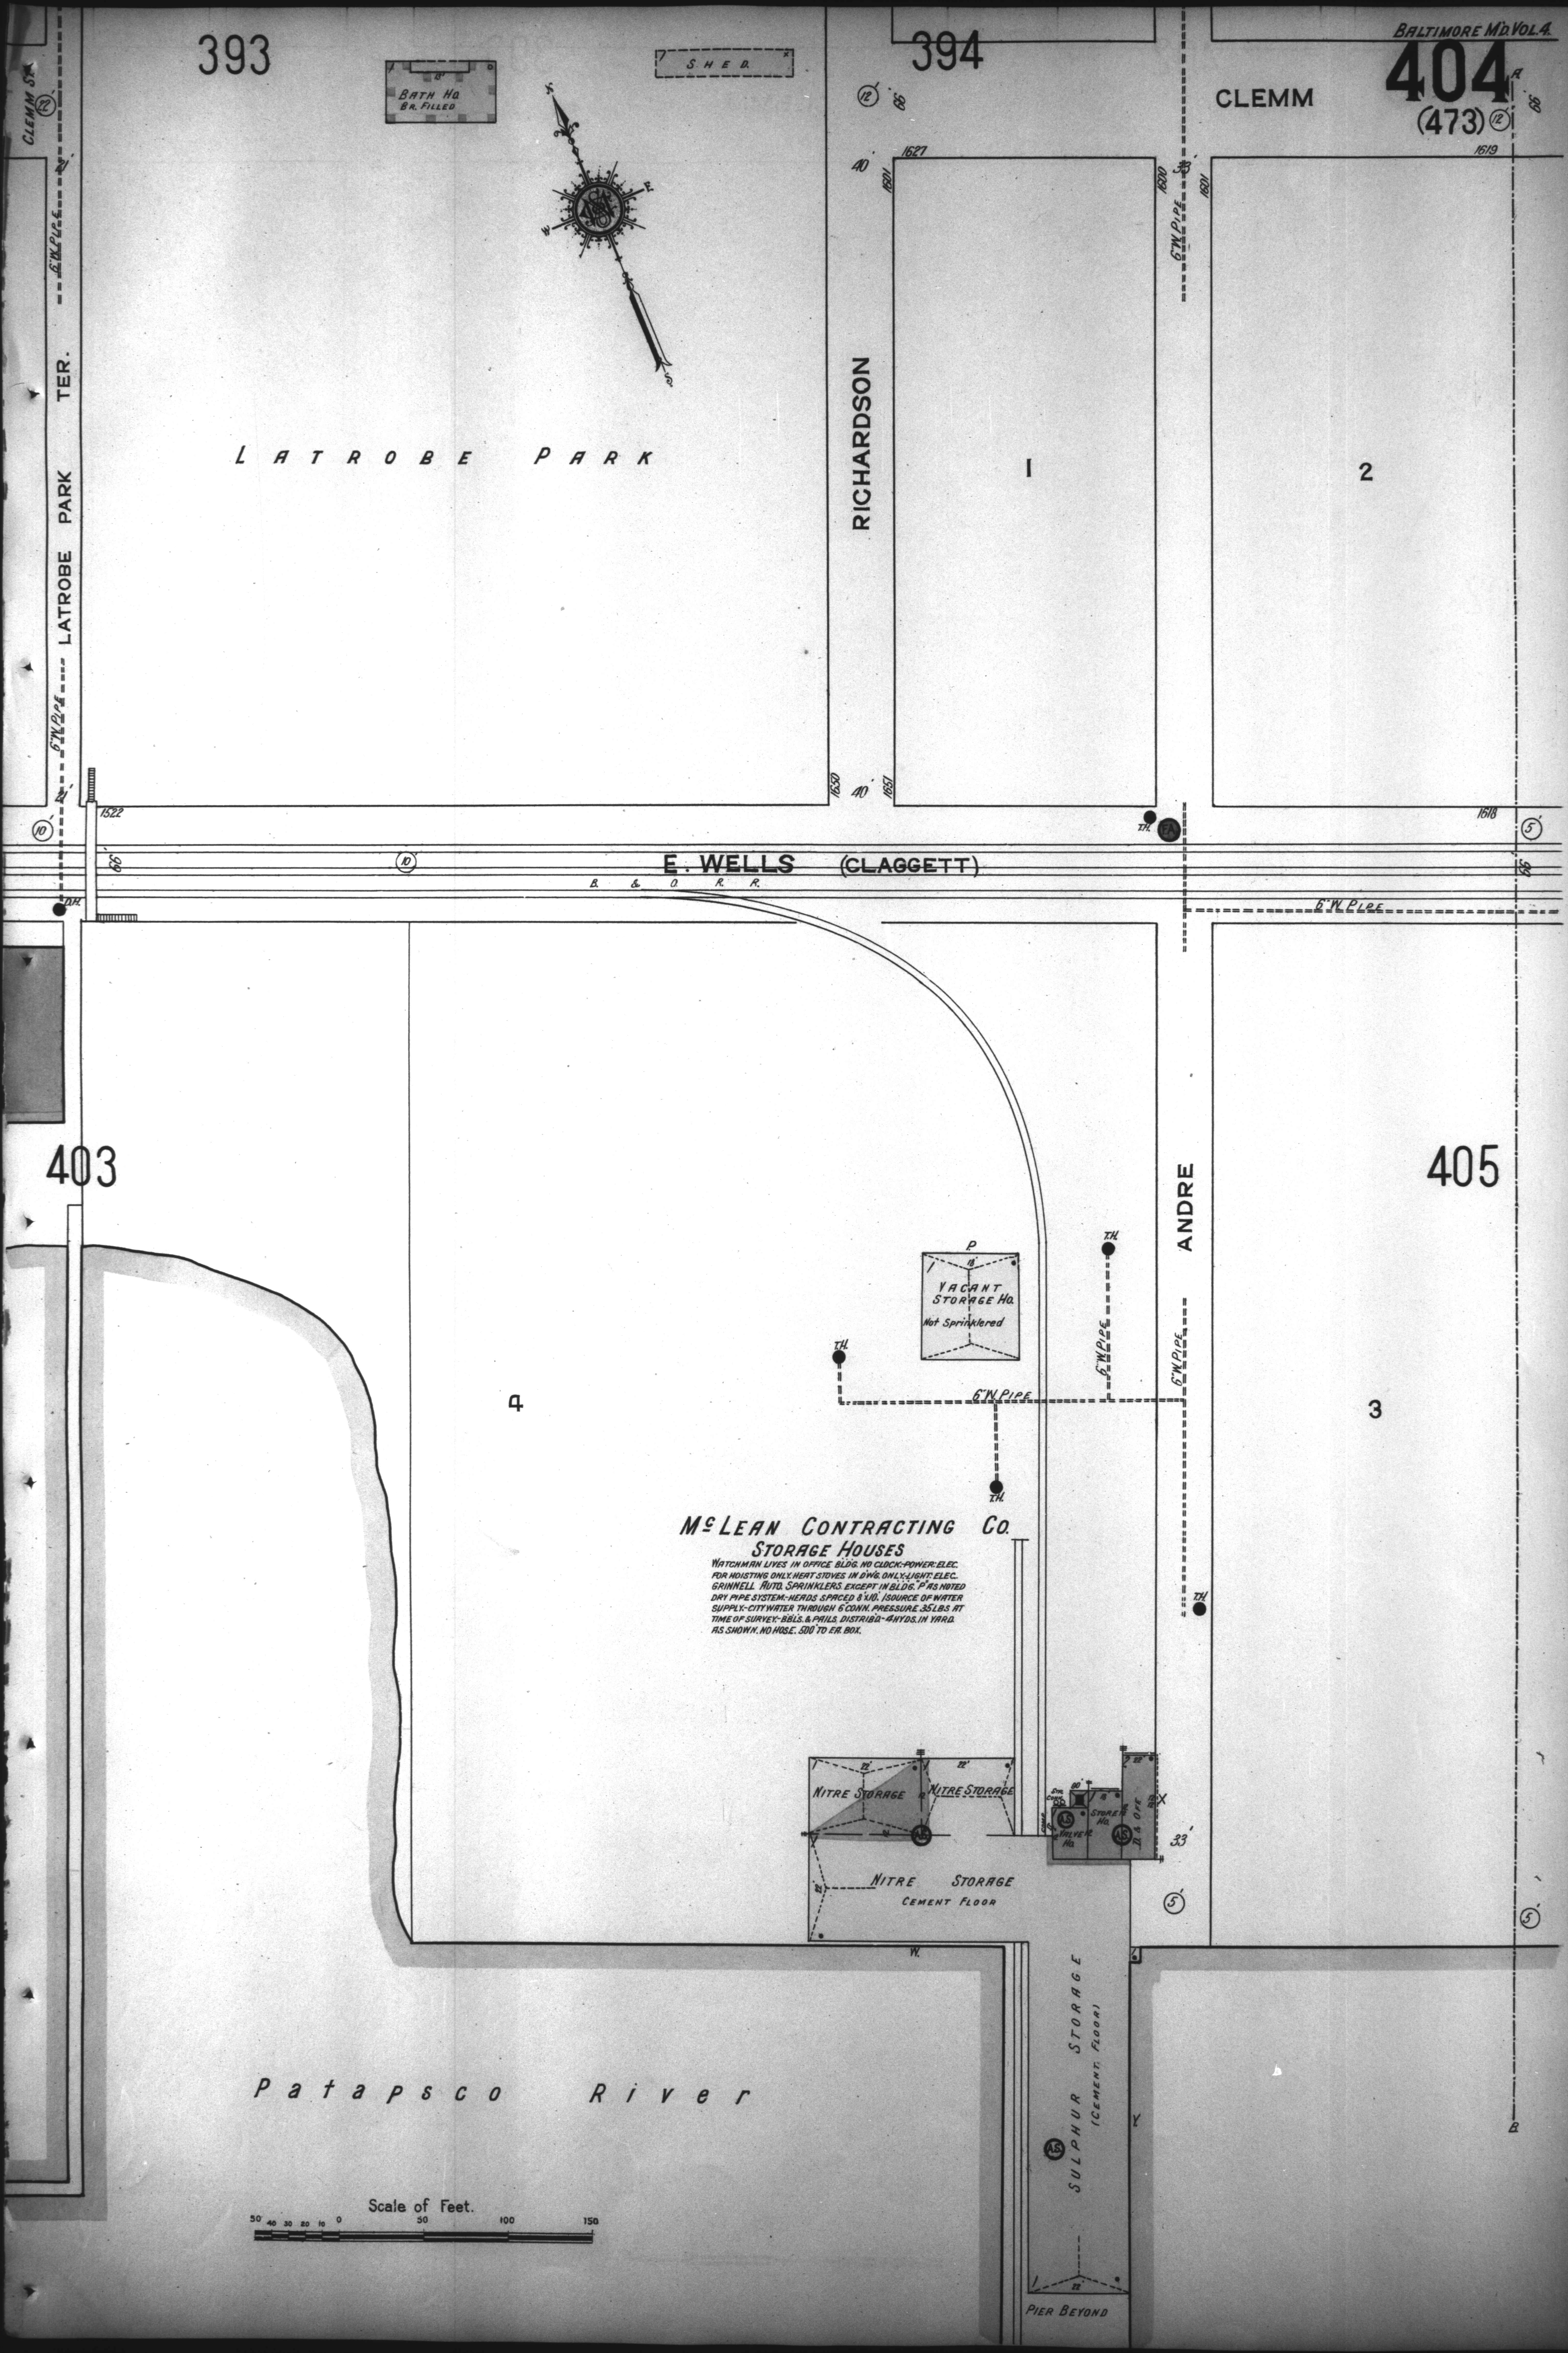
393
394
CLEMM
CLEMM ST.
LATROBE PARK TER.
6"W. PIPE
BATH HO.
BR. FILLED
SHED
LATROBE PARK
RICHARDSON
1627
1601
1651
1650
1600
1601
1619
1618
1522
40'
66'
33'
1
2
3
4
T.H.
F.A.
D.H.
E. WELLS (CLAGGETT)
B. & O. R. R.
6"W. PIPE
403
405
ANDRE
VACANT STORAGE HO.
Not Sprinklered
P
McLEAN CONTRACTING CO.
STORAGE HOUSES
WATCHMAN LIVES IN OFFICE BLDG. NO CLOCK:-POWER: ELEC. FOR HOISTING ONLY. HEAT STOVES IN D'WG. ONLY:-LIGHT: ELEC. GRINNELL AUTO. SPRINKLERS EXCEPT IN BLDG. "P" AS NOTED DRY PIPE SYSTEM:-HEADS SPACED 8'x10'. SOURCE OF WATER SUPPLY:-CITY WATER THROUGH 6" CONN. PRESSURE 35 LBS AT TIME OF SURVEY:-BBLS. & PAILS DISTRIB'D.-4 HYDS. IN YARD AS SHOWN. NO HOSE. 500' TO FA. BOX.
NITRE STORAGE
NITRE STORAGE
NITRE STORAGE
CEMENT FLOOR
STR. CONN.
VALVE HO.
STORE HO.
D. & OFF.
A.S.
SULPHUR STORAGE
(CEMENT FLOOR)
PIER BEYOND
Patapsco River
Scale of Feet.
50 40 30 20 10 0 50 100 150
N
S
E
W
A
B
W.
X
Y