BALTIMORE, MD. VOL. 4.

367

(443)

MD....004

FEDERAL TIN CO.
TIN CAN MFG.
BUILDINGS: E, F & H.
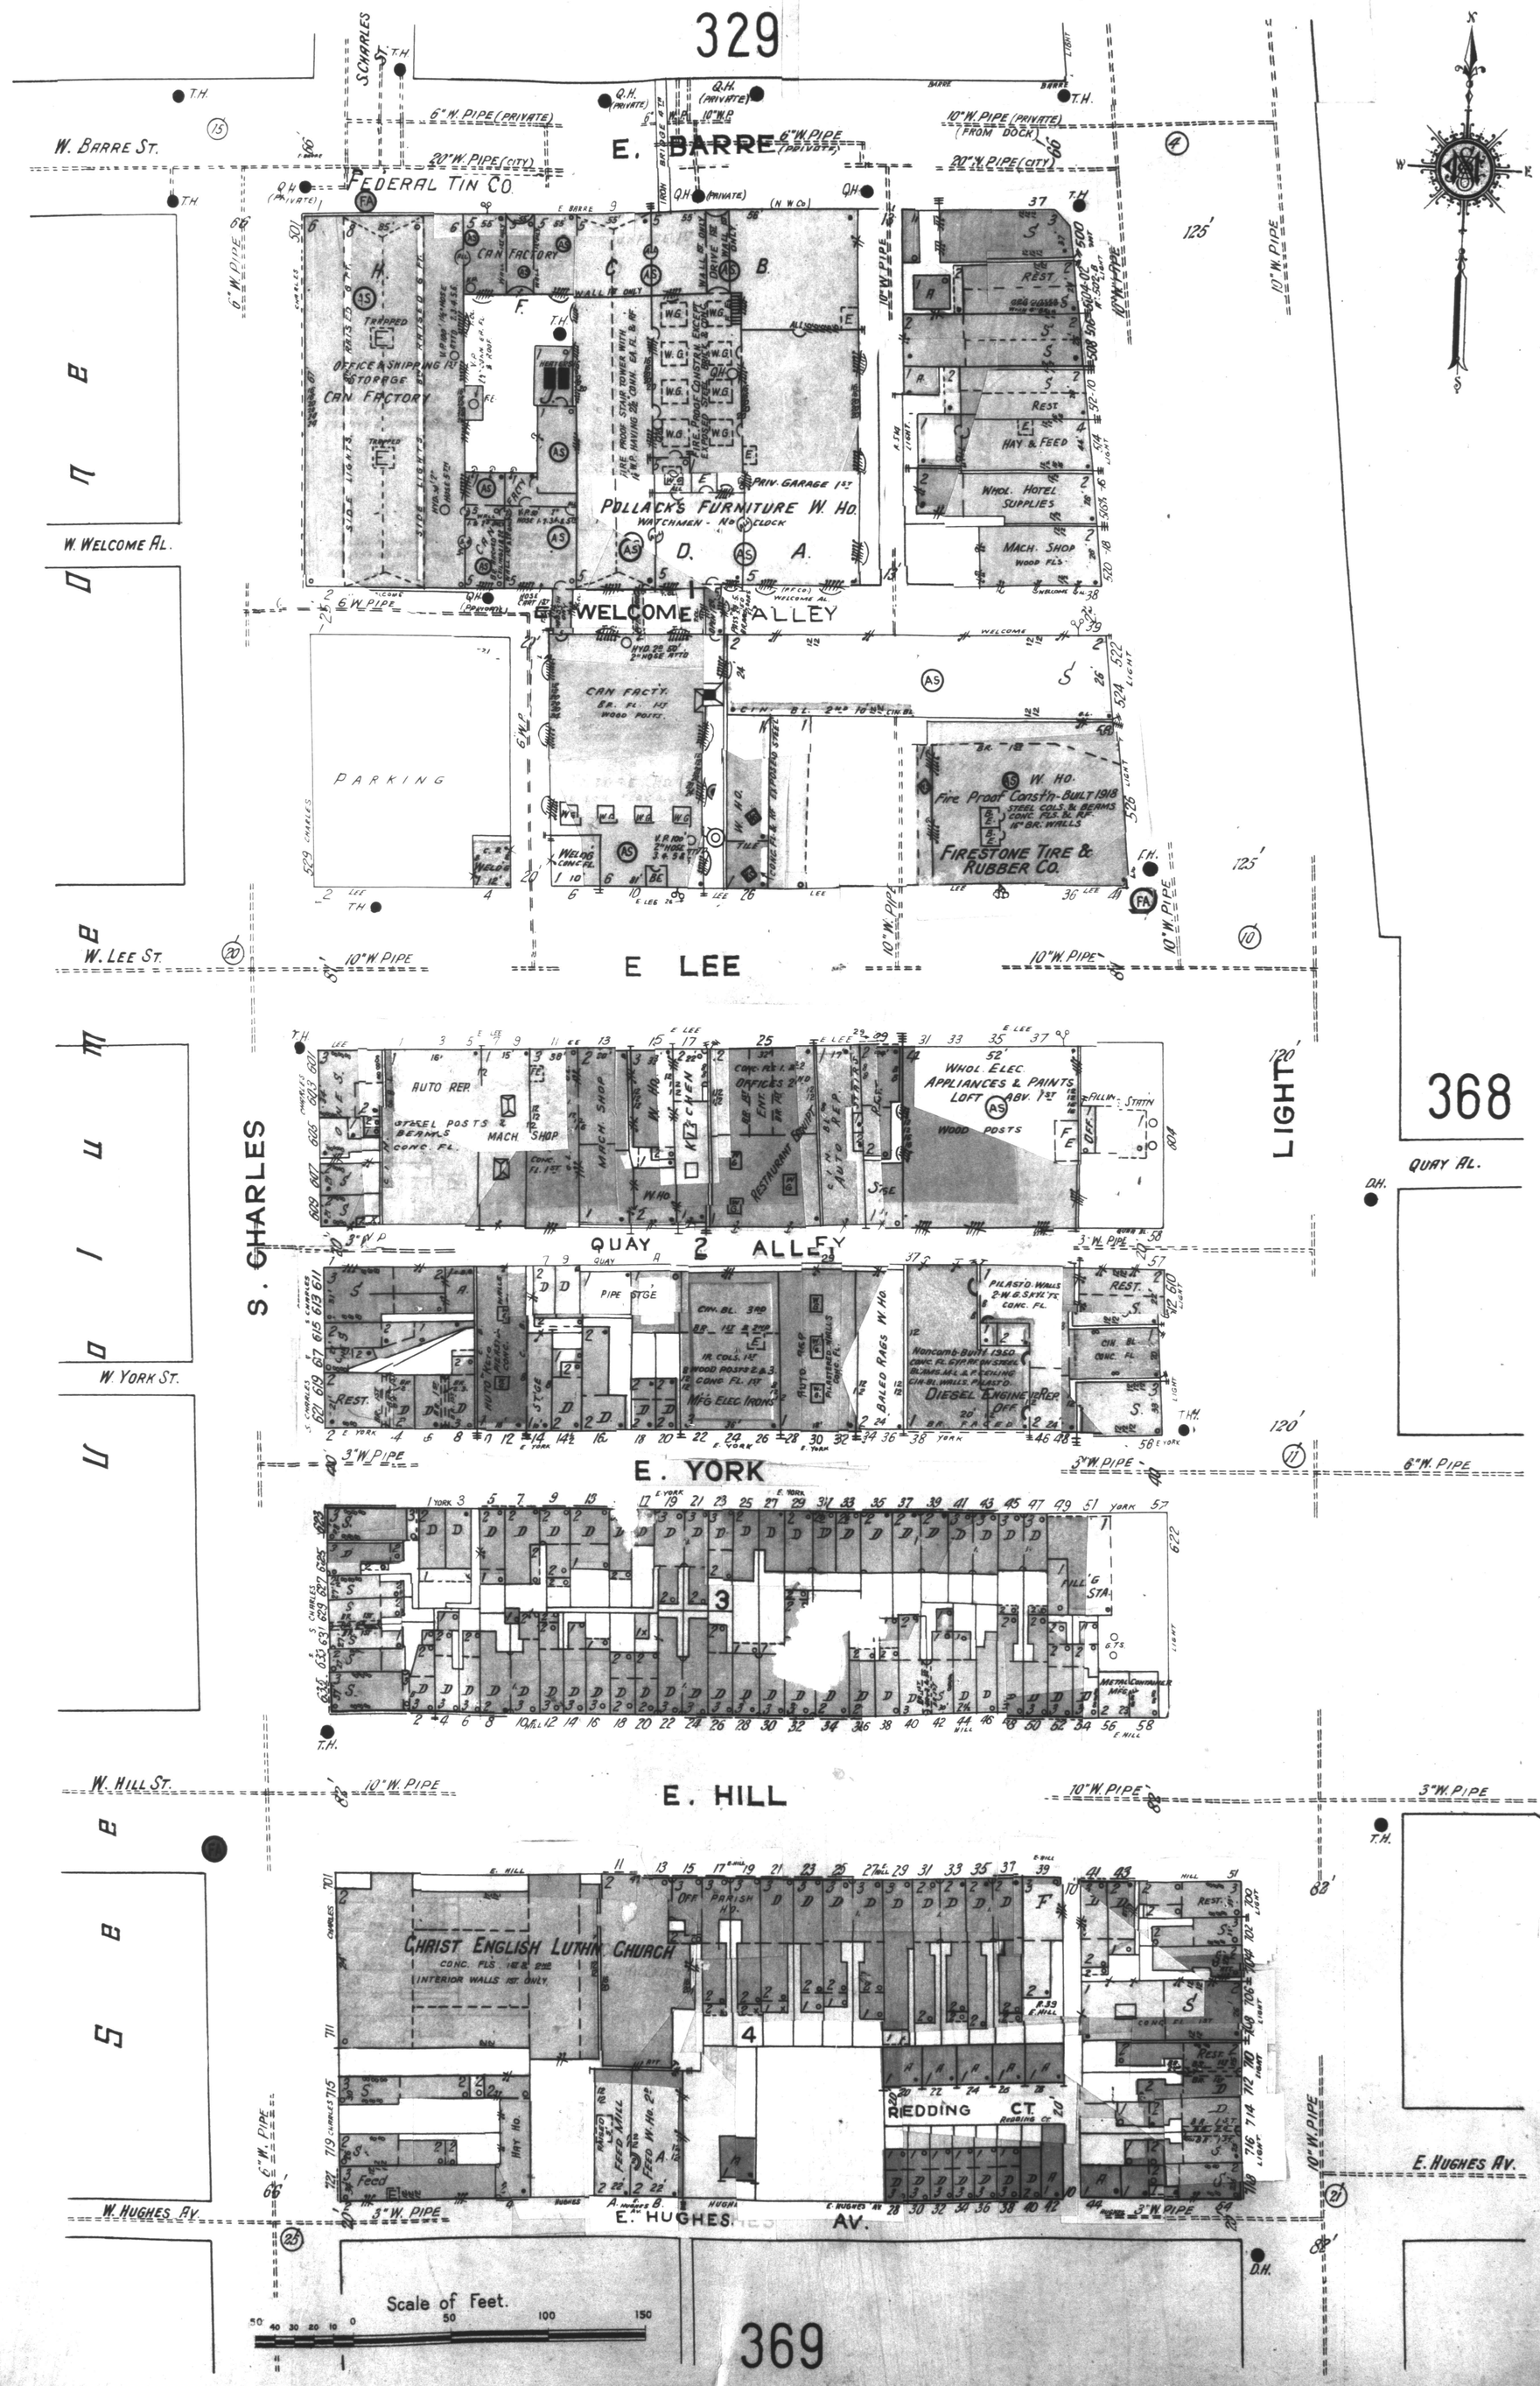
TWO NIGHT WATCHMEN - APP. CLOCK - POWER: ELEC - HEAT: STEAM - LIGHTS: ELEC. 4 VERT. PIPES AS SHOWN WITH 800' 1½" HOSE 450' 2" HOSE AND 300' 2½" HOSE. FIRE PAILS DISTRIBUTED. WATER SUPPLY FOR HOSE IS OBTAINED FROM 2 ADJOINING PLANTS OF THE AMERICAN TOBACCO CO. (SHEET 329 & 367.) THIS SUPPLY SYSTEM COMPRISES - TWO GRAVITY TANKS HAVING A COMBINED CAPACITY OF 27000 GALLONS - 2 FIRE PUMPS OF 750 GAL. CAPCY. PER MINUTE EACH AND ONE 10" CONN. TO CITY WATER MAINS 50 LBS PRESSURE. BREAK GLASS FIRE ALARM BOX ON EACH FLOOR. THE FIRE APPARATUS AND PRIVATE SYSTEM OF STREET HYDS. DISCRIBED IN THE REPORTS OF THE TWO ADJOINING PLANTS ARE AVAILABLE FOR USE IN THIS PLANT.