WATER FACILITIES:
Supply from two 8" driven wells, pumped to stand pipe, capcy 105,740 gals. by a Smith-Vaile duplex pump capcy. 500 gals. per min. - Normal pressure, from stand pipe 55 lbs. per sq. in. - Direct pumping gives less pressure than standpipe due to the lack of supply. - Average daily consumption 72,000 gals. - 40 O. Hyds. with 2½ miles 6" & 8" cast ir. pipe, laid in 1909. -

FIRE DEP'T:
Volunteer Co. 17 men. - 1 hose cart with 600' 2½" hose, 1 combination hose & H.&L. truck with 600' 2½" hose. - 2 Soda chem extg'rs. - Fire alarm given by whistle on Hokins Mill. - Streets level & piked. - Public lights elec. -

3675
4 SHEETS

MAY 31 1911

1

SANBORN MAP COMPANY.
POPULATION 1400
PREVAILING WINDS N.E.
WATER FACILITIES SEE NOTE
NO STEAM & NO HAND ENGINE
TWO HOSE CARTS
ONE HOOK & LADDER TRUCK
BERLIN
WORCESTER COUNTY
MARYLAND
MAY 1911
SCALE 50 FT. TO AN INCH
11 BROADWAY, NEW YORK.
COPYRIGHT 1911 BY THE SANBORN MAP COMPANY

©CLF 19306

Map Division
JUN. 9 1911
Library of Congress

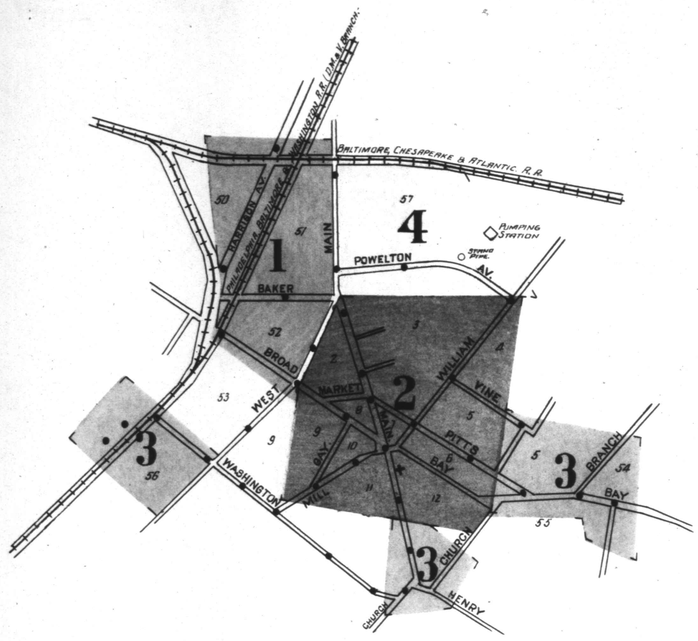

KEY

NUMBER OF STORIES
SHINGLE ROOF
COMPOSITION RY
SLATE OR TIN RY
FIRE WALL 6 IN. ABV ROOF
METAL CORNICE
FIRE WALL 12 IN. ABV ROOF.
WOOD CORNICE.
FIRE WALL 18 IN. ABV ROOF.
FRAME PARTITION.
OPENING WITH IRON DOOR.
" " "STANDARD" IRON DOOR
WINDOWS & IRON SHUTTERS.
WINDOW - 1ST STORY.
WINDOWS 1ST & 3RD STORIES
" 2ND & 4TH "
STABLE
BUILDINGS COLORED YELLOW ARE FRAME
" " RED BRICK
" " BLUE STONE
" " GRAY IRON
" " BROWN ADOBE
" " GREEN SPECIALS
(5) (27) INDICATE RELATIVE HEIGHTS.
FIRE STATION, AS SHOWN ON KEY MAP.
ALTERNATE STREET NUMBERS ARE ACTUAL.
CONSECUTIVE STREET NO'S ARE ARBITRARY.

INDEX

SPECIALS.

	SHEET
A	
Adkins Co., General Millwork,	1
Atlantic Hotel,	2
B	
B. C. & A. R. R. Pass. Station,	1
Berlin Light and Water Works,	4
" Milling Co.,	4
" Veneer Works,	3
Buckingham High School,	2
F	
Fire Department,	2
L	
Library,	2
M	
Majestic, The,	2
Methodist Episcopal Church,	2
P	
Park Hotel,	2
Post Office,	2
Presbyterian Church,	3
S	
St. Paul's Church,	3
W	
Whaley, T. J., Saw & Planing Mill	3

THE ADKINS CO. GENERAL MILL WORK
HEAT STOVE IN OFFICE & GLAZING ROOM ONLY. - NO LIGHTS - POWER STEAM. - HEAT STOVE IN WATCHMAN. - IMPROVED CLOCK & STATIONS & BUGLE. - FUEL WASTE. - NIGHT WATCHMAN. - DISTRIBUTED HOSE BE SHOWN - V.P.'S WITH HOSE TO BE ATTACHED. - CHEMICAL TANKS AS SHOWN. - SHAVINGS BLOWN TO VAULT.

HARRISON AV.

BALTIMORE & WASHINGTON R.R. (D. M. & V. B. R. R.)

BALTIMORE, CHESAPEAKE & ATLANTIC R.R.

PASSENGER DEPOT

BRICK PLATFORM

WATER TANK

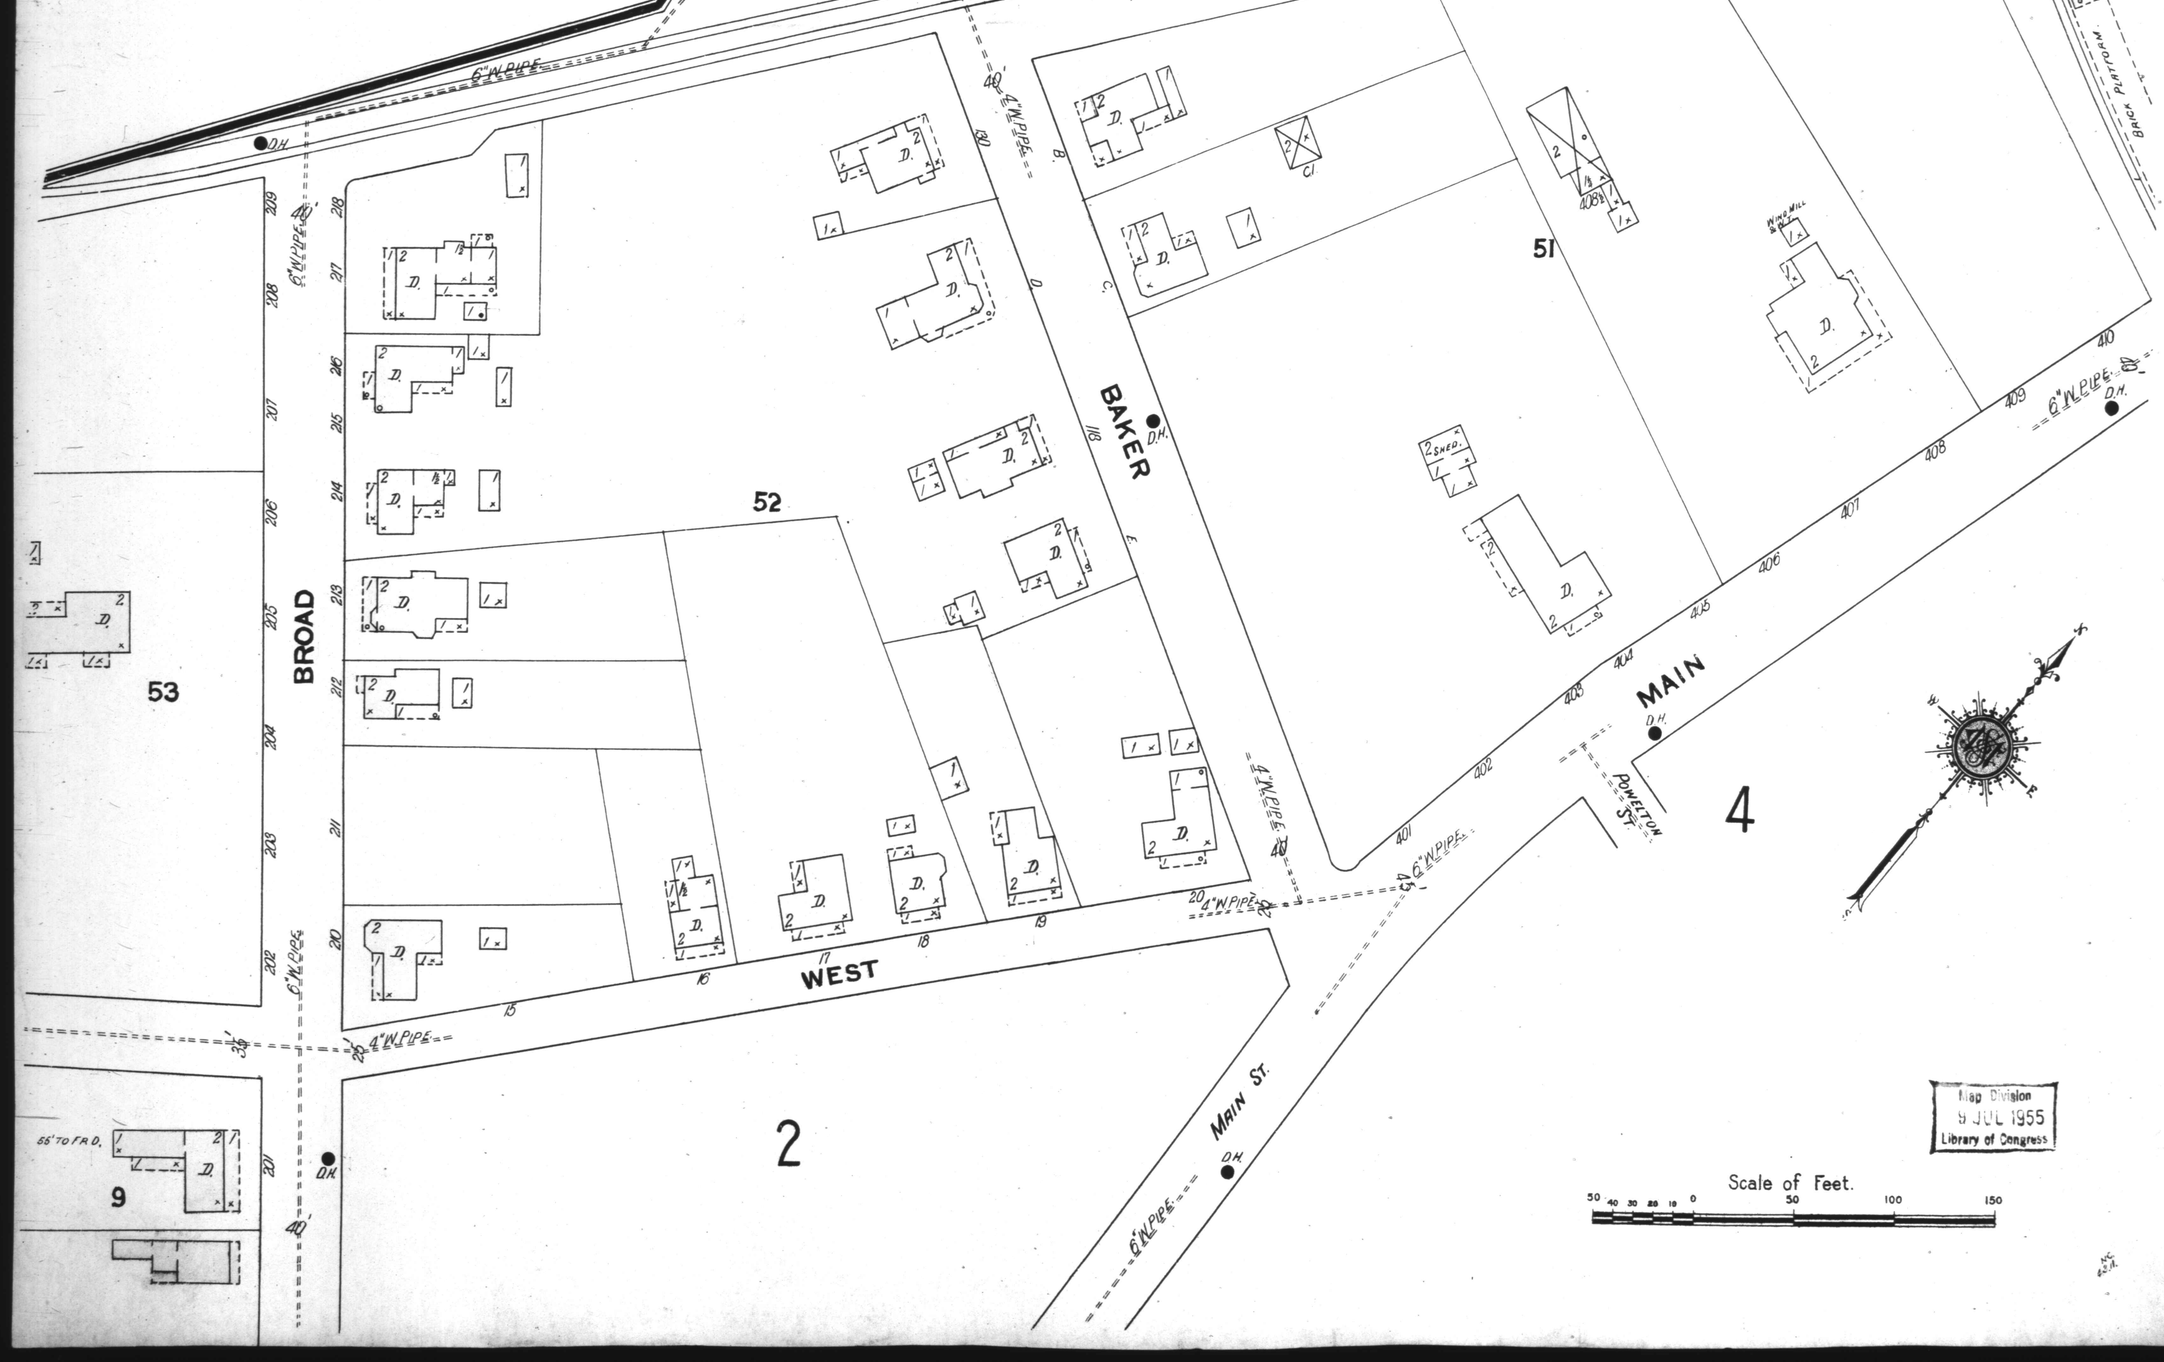

Map Division
9 JUL 1955
Library of Congress