ST. MICHAELS, MD.

SEPT. 1907 — EASTON MD. — 16

POPULATION: 1900.
PREVAILING WINDS: N.W. AND S.W.

WATER FACILITIES:
Town Water Works. Installed 1900. Direct Pressure System, and elevated Storage Tank. Tank 24' in Diameter, 20' high, 75' above the Ground. Capy.- 65,000 Gals., supply: 8" Well. 200' deep, never fails. One 30 HP Gasoline Eng. in Pumping Station. One 3" Stillwell-Bierce and Smith-Vaile Pump. Capy. 160 Gals. per Min. Pressure 46 Lbs. per Sq. Inch. Daily Consumption 30,000 Gals. 1½ Miles of 8", 6" and 4" Water Pipe. 18 double Hydrants. Harbor always open.

FIRE DEPARTMENT:
Volunteer 42 Men. Engineer paid. One Hook and Ladder Truck. 2 Hose Carts. 500' 2½" Hose, 66 Buckets, Fire Alarm: 2 Church Bells. High School Bell and Town Bell. 1 Night Patrol with 2 Clocks. 1 at Watkins and Dodson's Mill on Chew Av. The other at Dr. Seths Off. at Corner of Dodson Av. and Talbot St. Reports at each Clock. Hourly.
Streets level and not paved.

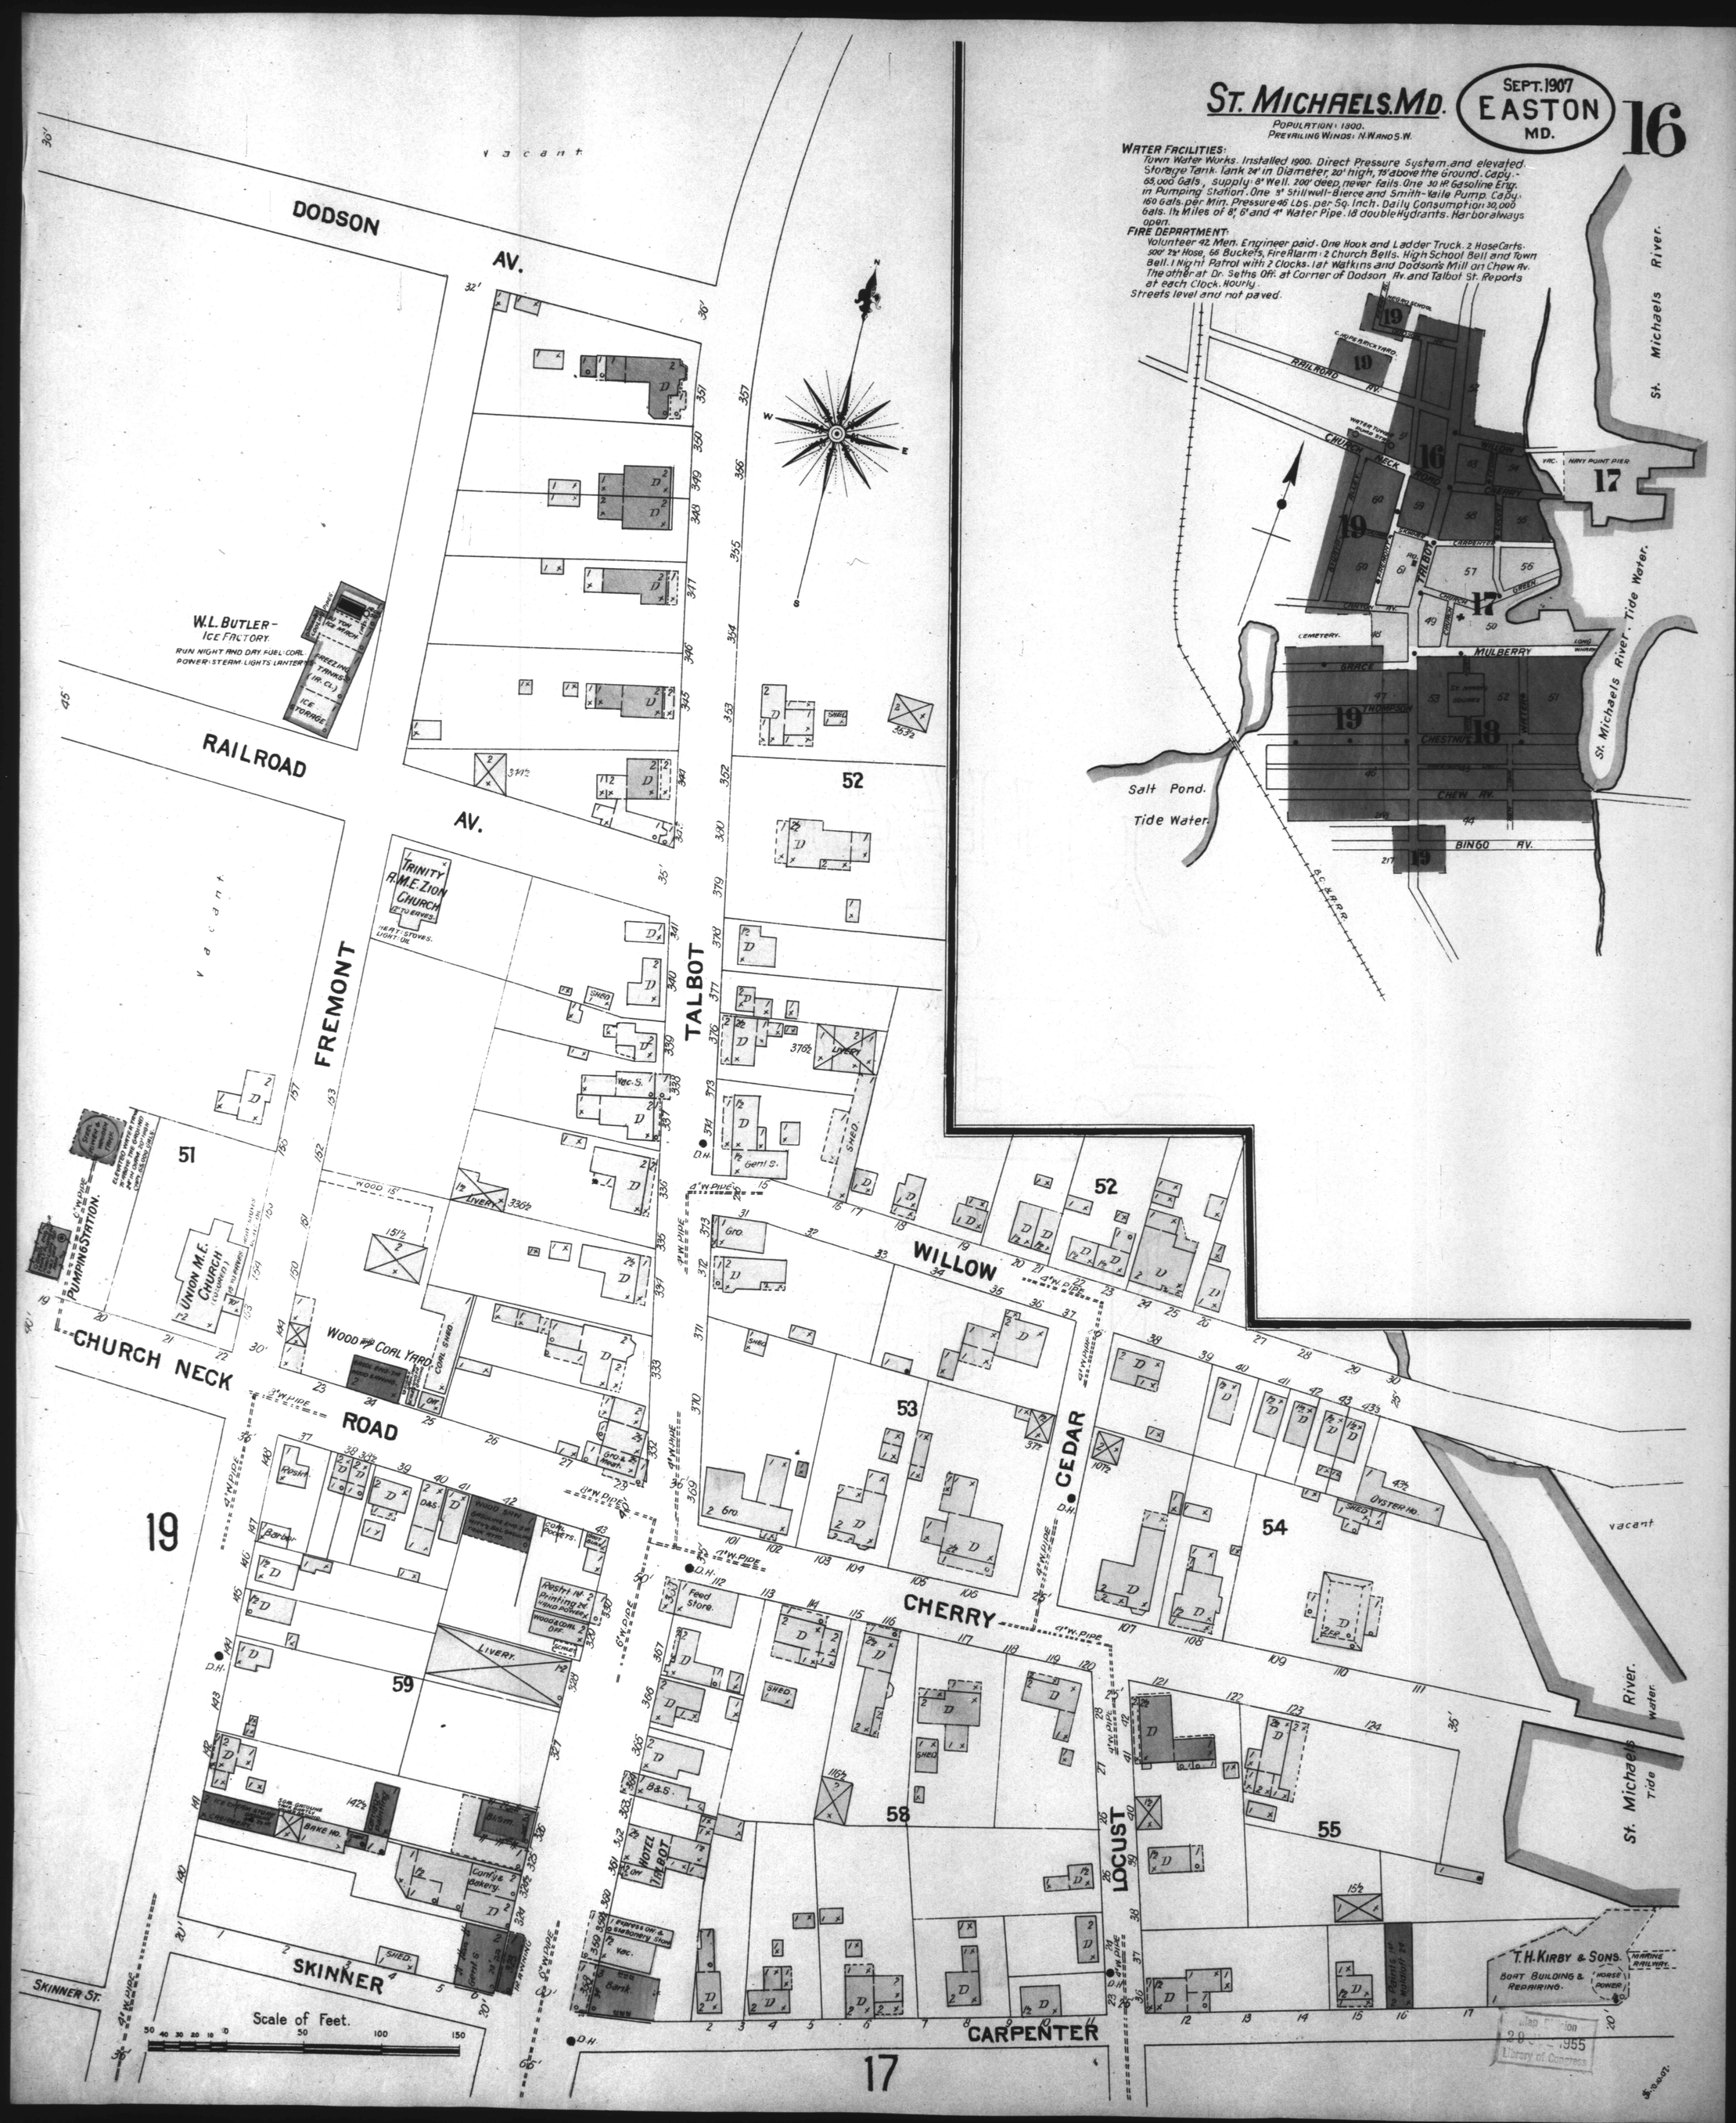

Map Division
20 OCT 1955
Library of Congress