(4 SHEETS)

1

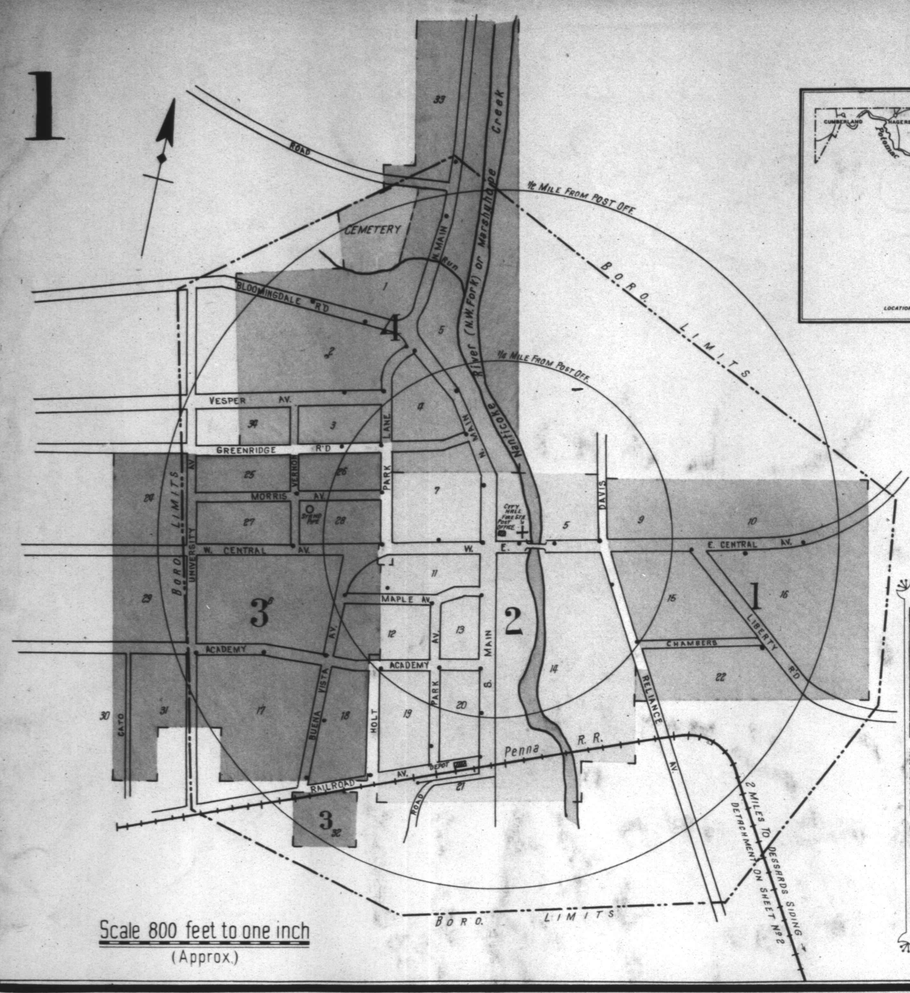

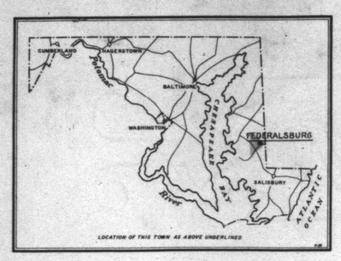

INDEX

STREETS

	SHEET
A	
Academy, 15–32, arbitrary	3
" 100–129	2
" 128–225	3
Addis Place (arbitrary),	1
B	
Bank, see W. Central Ave.	
Bloomingdale Road, 100–135	4
Bridge, see E. Central Ave.	
Buena Vista Ave.,	3
C	
Cato (arbitrary),	3
Central Ave., E., 100–127	2
" " " 200–275	1
" " W., 100–121	2
" " " 200–325	3
Chambers,	1
D	
Davis,	1 & 2
Deane Place, see Davis.	
F	
First, see Vesper Ave.	
G	
Greenridge Road,	3 & 4
H	
Holt, 100–124	*2
" 101–125	*3
L	
Liberty Road,	1
M	
Main, N., 100–125	2
" " 126–140	*2
" " 127–141	*4
" " 142–721	4
" S., 100–329	2
Maple Ave., 100–121	2
" " 122–131	3
Morris Ave.,	3
P	
Park Ave.,	2
" Lane,	2, 3 & 4
Penn, see Morris Ave.	
R	
Railroad Ave.,	2 & 3
" Place, see Railroad Ave.	
Reliance Ave.,	1 & 2
S	
Seaford Road, see Reliance Ave.	
U	
University Ave.,	3
V	
Vernon,	3 & 4
Vesper Ave., 100–149	4

SPECIALS

B	
Bell, G. T., & Son, Federalsburg Flour Mills,	2
C	
Christ M. P. Church,	2
Church of God,	4
E	
Excelsior Pearl Works, Inc., Button Mfg.,	1
F	
Federal Theatre,	2
Federalsburg Flour Mills,	2
" Lumber and M'f'g Co.,	2
M	
Municipal Building,	2
N	
Noble, J. H., Lumber and Mill Works,	2
O	
Opera House,	2
P	
P. R. R. Depots,	2
Post Office,	2
Public School,	3
R	
River View Inn,	2
S	
Sunshine Laundry,	2
T	
Topkins Bros. Co., Underwear M'f'g,	2
U	
Union Methodist Episcopal Church,	4
W	
Wright, J., Canning Factories,	2 & 3
Z	
Zion Memorial M. E. Church,	4

* Indicates only one side of street shown.

1

SANBORN MAP COMPANY

POPULATION 1369

PREVAILING WINDS S. W.

FOR WATER FACILITIES AND FIRE DEPARTMENT, SEE REPORT.

FEDERALSBURG

CAROLINE COUNTY

MARYLAND

FEB. 1932

NEW YORK

COPYRIGHT 1932 BY THE SANBORN MAP COMPANY
GREAT CARE HAS BEEN EXERCISED IN THE PRODUCTION OF OUR PUBLICATIONS AND OUR SERVICE, BUT ABSOLUTE ACCURACY IS NOT GUARANTEED.

©cf san. 1031

MAY 14 1932

WATER FACILITIES:

Gravity system.- Municipally owned.- Water pumped from 2-36" conc. wells, 1,500 gal's per min each, to 150,000 gal. tank, raised 100' above center of town by 2 centrifugal pumps, one 500 to 650 gal's per min. & one 250 to 300 gal's per min, both electrically driven & by one centrifugal pump, 500 to 700 gal's per min, gasoline driven, one auxiliary vacuum pump gasoline driven.- 16,000' of 8" pipes, 8,000' of 6" pipes,- 50 triple hyd's.- Average pressure: 50 lbs.- Average daily consumption: 200,000 gal's.-

FIRE DEPT:

Volunteer.- 40 active members.- 1 chief.- 2 assistants. No paid members.- One Reo chassis with Howe pumper of 350 gal. capacity, 50 gal. Booster tank, 800' 2½" hose.- One Reo chassis with Hale pumper of 500 gal. capacity, 60 gal. Booster tank, 1,000' 2½" hose.- Total hose: 2,000' 2½".- Siren on Fire Hq. No fire limits.-

Main, Central & Academy St's paved.-
Grades: level.-
Public lighting: elec.

NOTE:

No fire-resistive roofing ordinance.-

Division of Maps
JUN -4 1932
Library of Congress

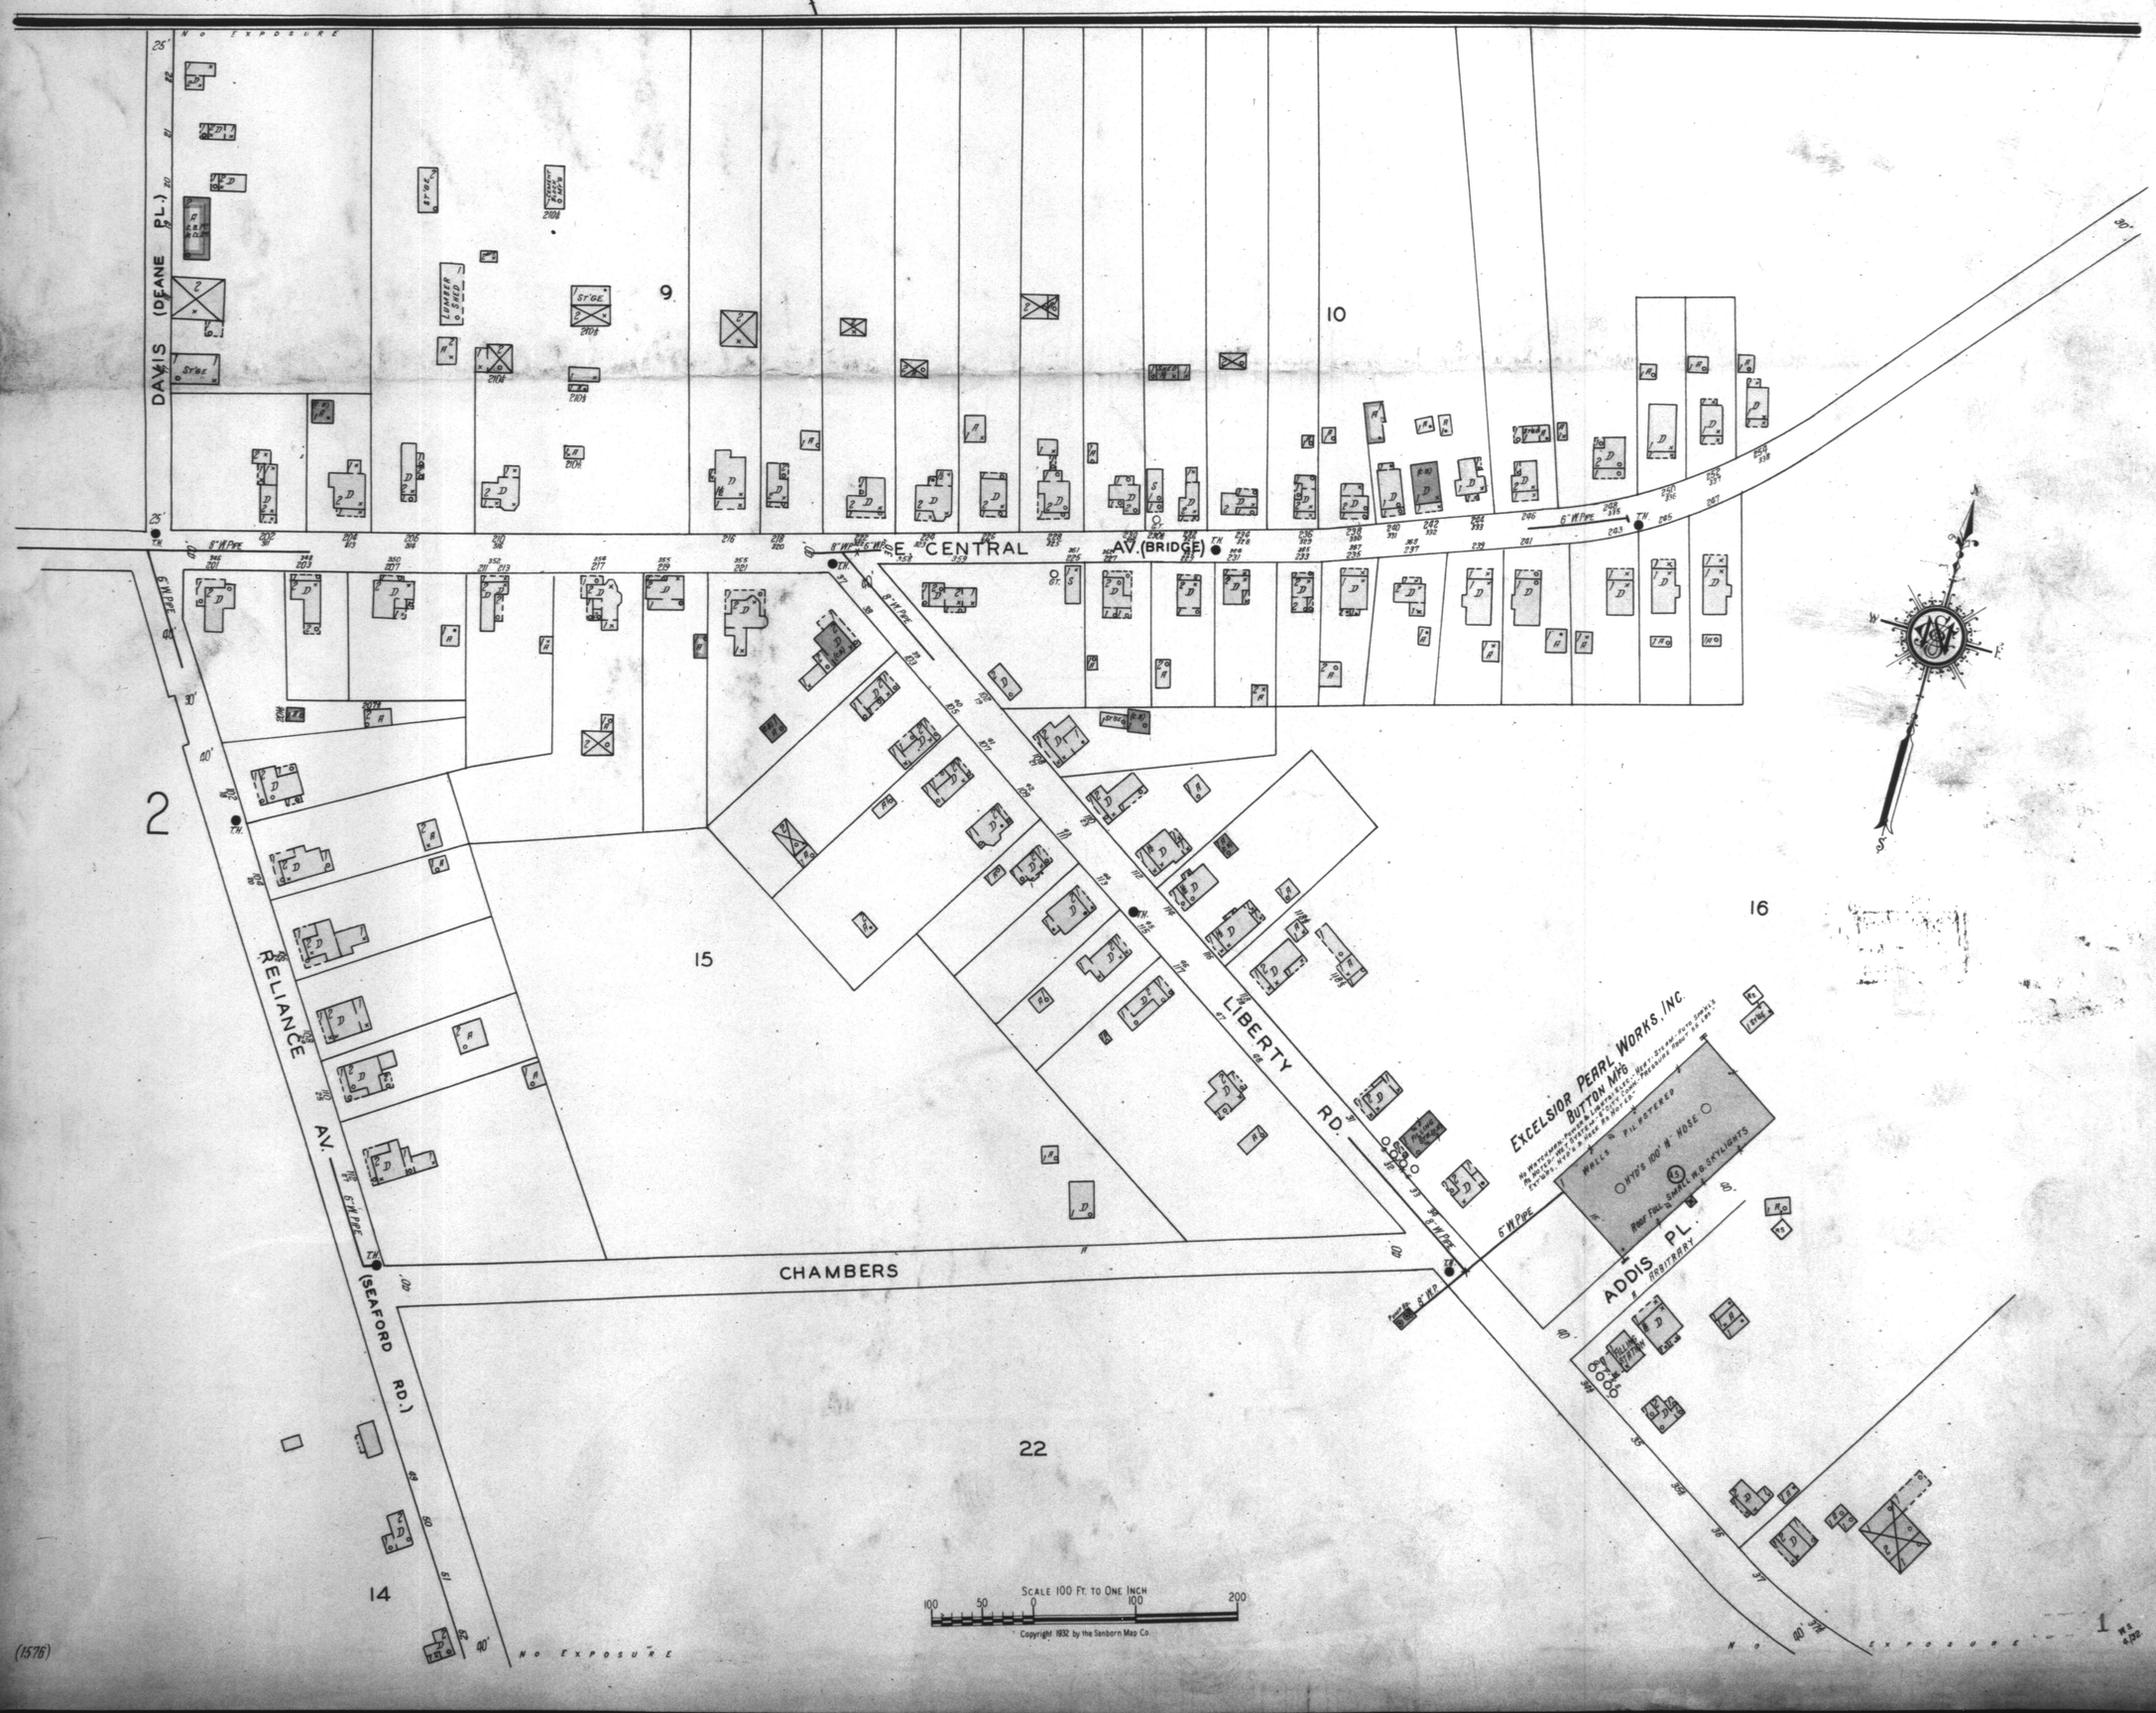

(1576)