JULY 1910
HAGERSTOWN
MD.

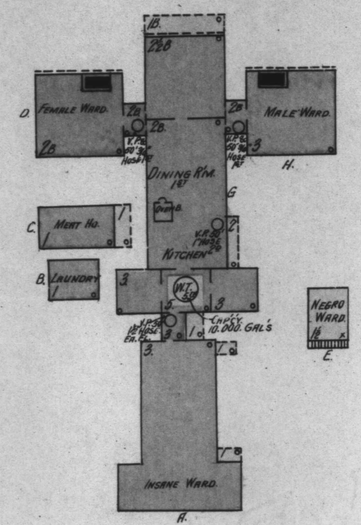

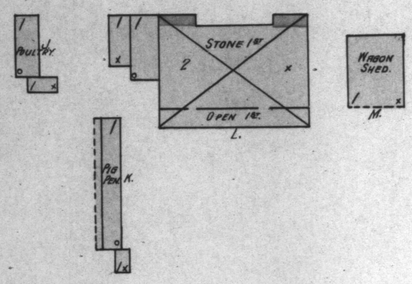

BELLVIEW ASYLUM
WASHINGTON COUNTY HOUSE & INSANE ASYLUM.

HEAT: STEAM.-- LIGHT: ELECTRIC WATER TANK CAPCY 10000. GAL'S ON 5TH FLOOR. SUPPLY BY PUMP DRAWING FROM WELL. OPERATED BY ELEC. MOTOR. 4 H.P.S. WITH HOSE ATT'D AS SHOWN.



Located 2 Miles N. of Court Ho.





ST JAMES SCHOOL.

HEAT: STEAM.-- FUEL: COAL.-- LIGHTS: ACETYLENE GAS. NO FIRE APP.

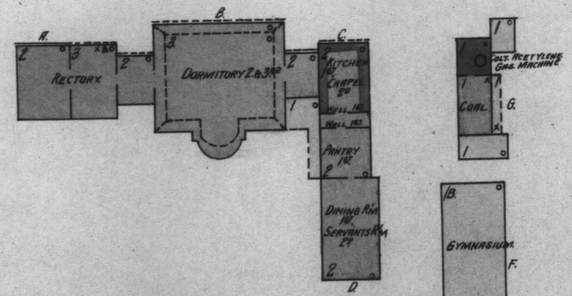



Located 6 Miles S. of Court Ho.

Scale of Feet.
50 40 30 20 10 0 50 100 150

Map Division
29 JUL 1955
Library of Congress

E.M. 52.10.