(3573)
(3 SHEETS)

1

SANBORN MAP COMPANY

POPULATION, 600

PREVAILING WINDS, WEST

FOR WATER FACILITIES AND FIRE DEPARTMENT, SEE REPORT

LEONARDTOWN

ST. MARY'S COUNTY

MARYLAND

JUNE 1928

NEW YORK

COPYRIGHT 1928 BY THE SANBORN MAP COMPANY
GREAT CARE HAS BEEN EXERCISED IN THE PRODUCTION OF OUR PUBLICATIONS AND OUR SERVICE, BUT ABSOLUTE ACCURACY IS NOT GUARANTEED

WATER FACILITIES: - Owned by Town. Water from artesian well flows into reservoir (27,000 Gal. cap.) located in F.W. Cisel's Ice Plant. Pumped from reservoir by 3 pumps direct to mains, overflow going to 100,000 Gal. W. Tel. Ref. Tk. Abv ground. - **Pumps:** - 1 Fairbanks-Morse triplex elec. driven, cap.: 25 Gals. per min.; from 24 to 71 ft. 1 Fairbanks-Morse centrif. vert. pump, cap.: 250 Gals. per min. - 1 Fairbanks-Morse triplex, pump driven by oil eng. cap.: 3200 Gals. per min. - Average daily consumption: 50,000 Gals. - Water pressure: 62 lbs. per sq. inch. - 2 Miles 6" to 8" mains. - 28 Triple hyds. -

FIRE DEP'T: - Volunteer. - 15 men. - 1 chief. - 1 ass't. - **Apparatus:** One Cadillac fire truck. - 240 Gal. chem. tanks. - 300' chem. hose. - 1000 2½" hose. - Fire alarm by elec. siren in center of Park. -

Public lights: elec. - Main streets paved. - Grades nearly level. - No fire limits. -

INDEX

SPECIALS
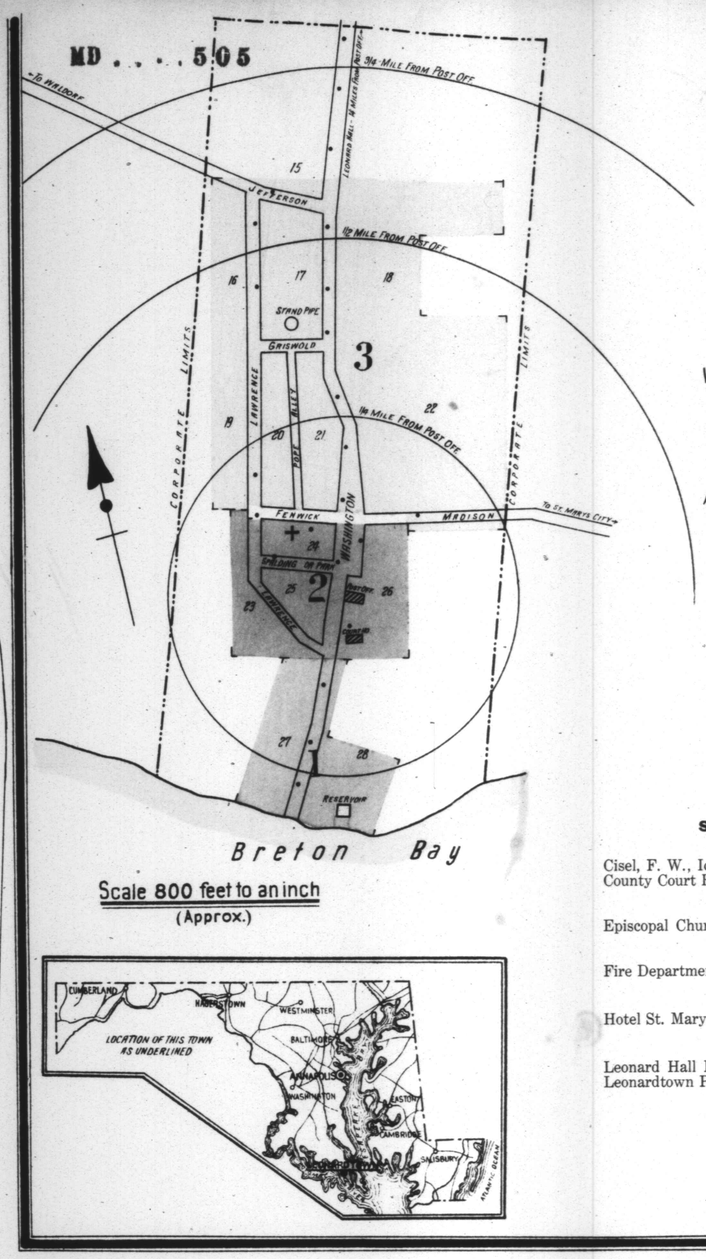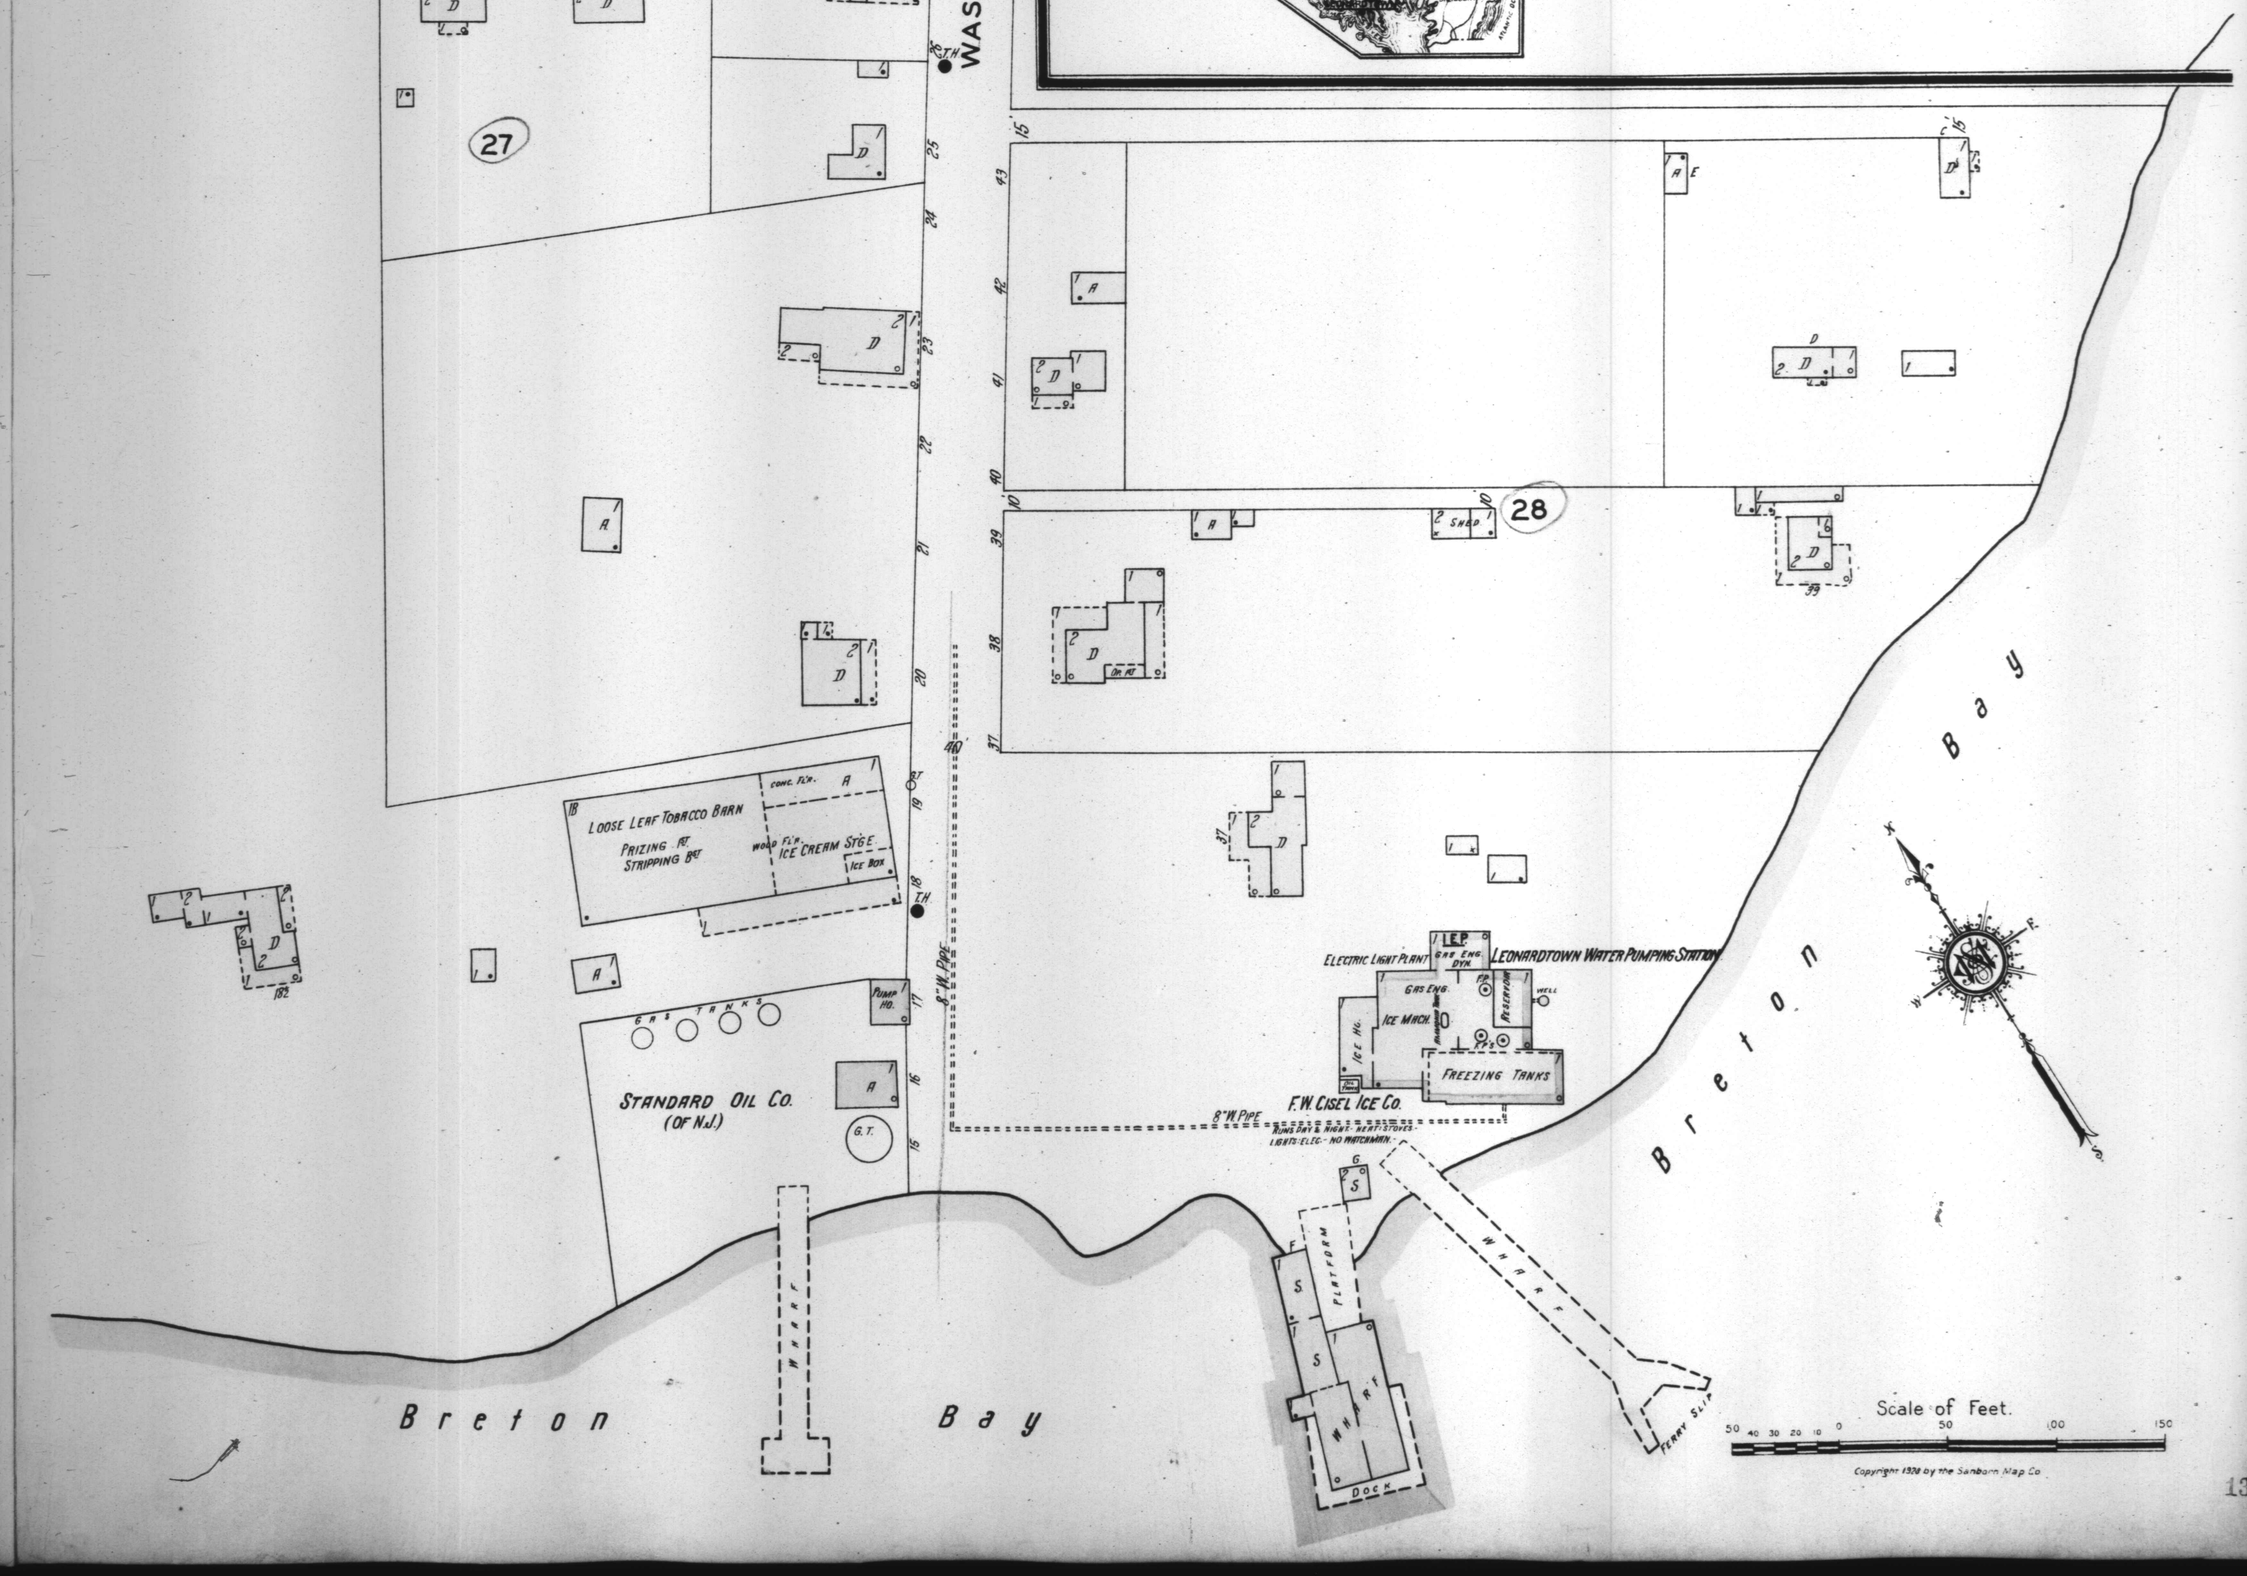
	SHEET
C	
Cisel, F. W., Ice Co.,	1
County Court House and Jail,	2
E	
Episcopal Church,	3
F	
Fire Department,	2
H	
Hotel St. Mary's,	2
L	
Leonard Hall Prep. School for Boys,	3
Leonardtown Public School,	3
Leonardtown Water Pumping Station and Electric Light Plant,	1
P	
Post Office,	2
S	
St. Aloysius' R. C. Church,	3
" Mary's Academy (Girls),	3
" Paul's M. E. Church,	3
Southern Maryland Bottling Co.,	2
Standard Oil Co. of New Jersey,	1
T	
Town Hall,	3
V	
Valentine Hall (Colored),	2