WATER FACILITIES:

Water Works owned & operated by Anne Arundel County Sanitary Commission - Water supply from 2 artesian wells & pumped direct into mains by 1 Rumsay triplex pump, capcy 100 gals per min. & 1 Fairbanks centr. pump, capcy 235 gals per min., overflow goes into 100,000 gal. water tk, base elev. 65' above ground. - 3 miles of 4", 6" & 8" water mains 24 triple hyd. - Average pressure 50 lbs per sq in. - Average daily consumption 100,000 gals. -

FIRE DEPT:

1 Volunteer company, 1 chief, 1 asst chief, 1 capt, 2 lieuts & 200 men - 1 station - 1 U.S. fire app. truck, pumpg capcy 600 gals per min. 325 gal. W. Tk - 600' 1" rubber hose 1200' 2½" hose - 1 U.S. fire app. truck, pumping capcy 350 gals per min. - 350 gal. water tk. 600' 1" rubber hose - 1200' 2½" hose - Fire alarm by telephone & siren on fire station - No fire limits. -

Topography nearly level - Camp Meade Rd, Maple Rd & Hammonds Ferry Rd paved, other St's not paved but in good condition. -
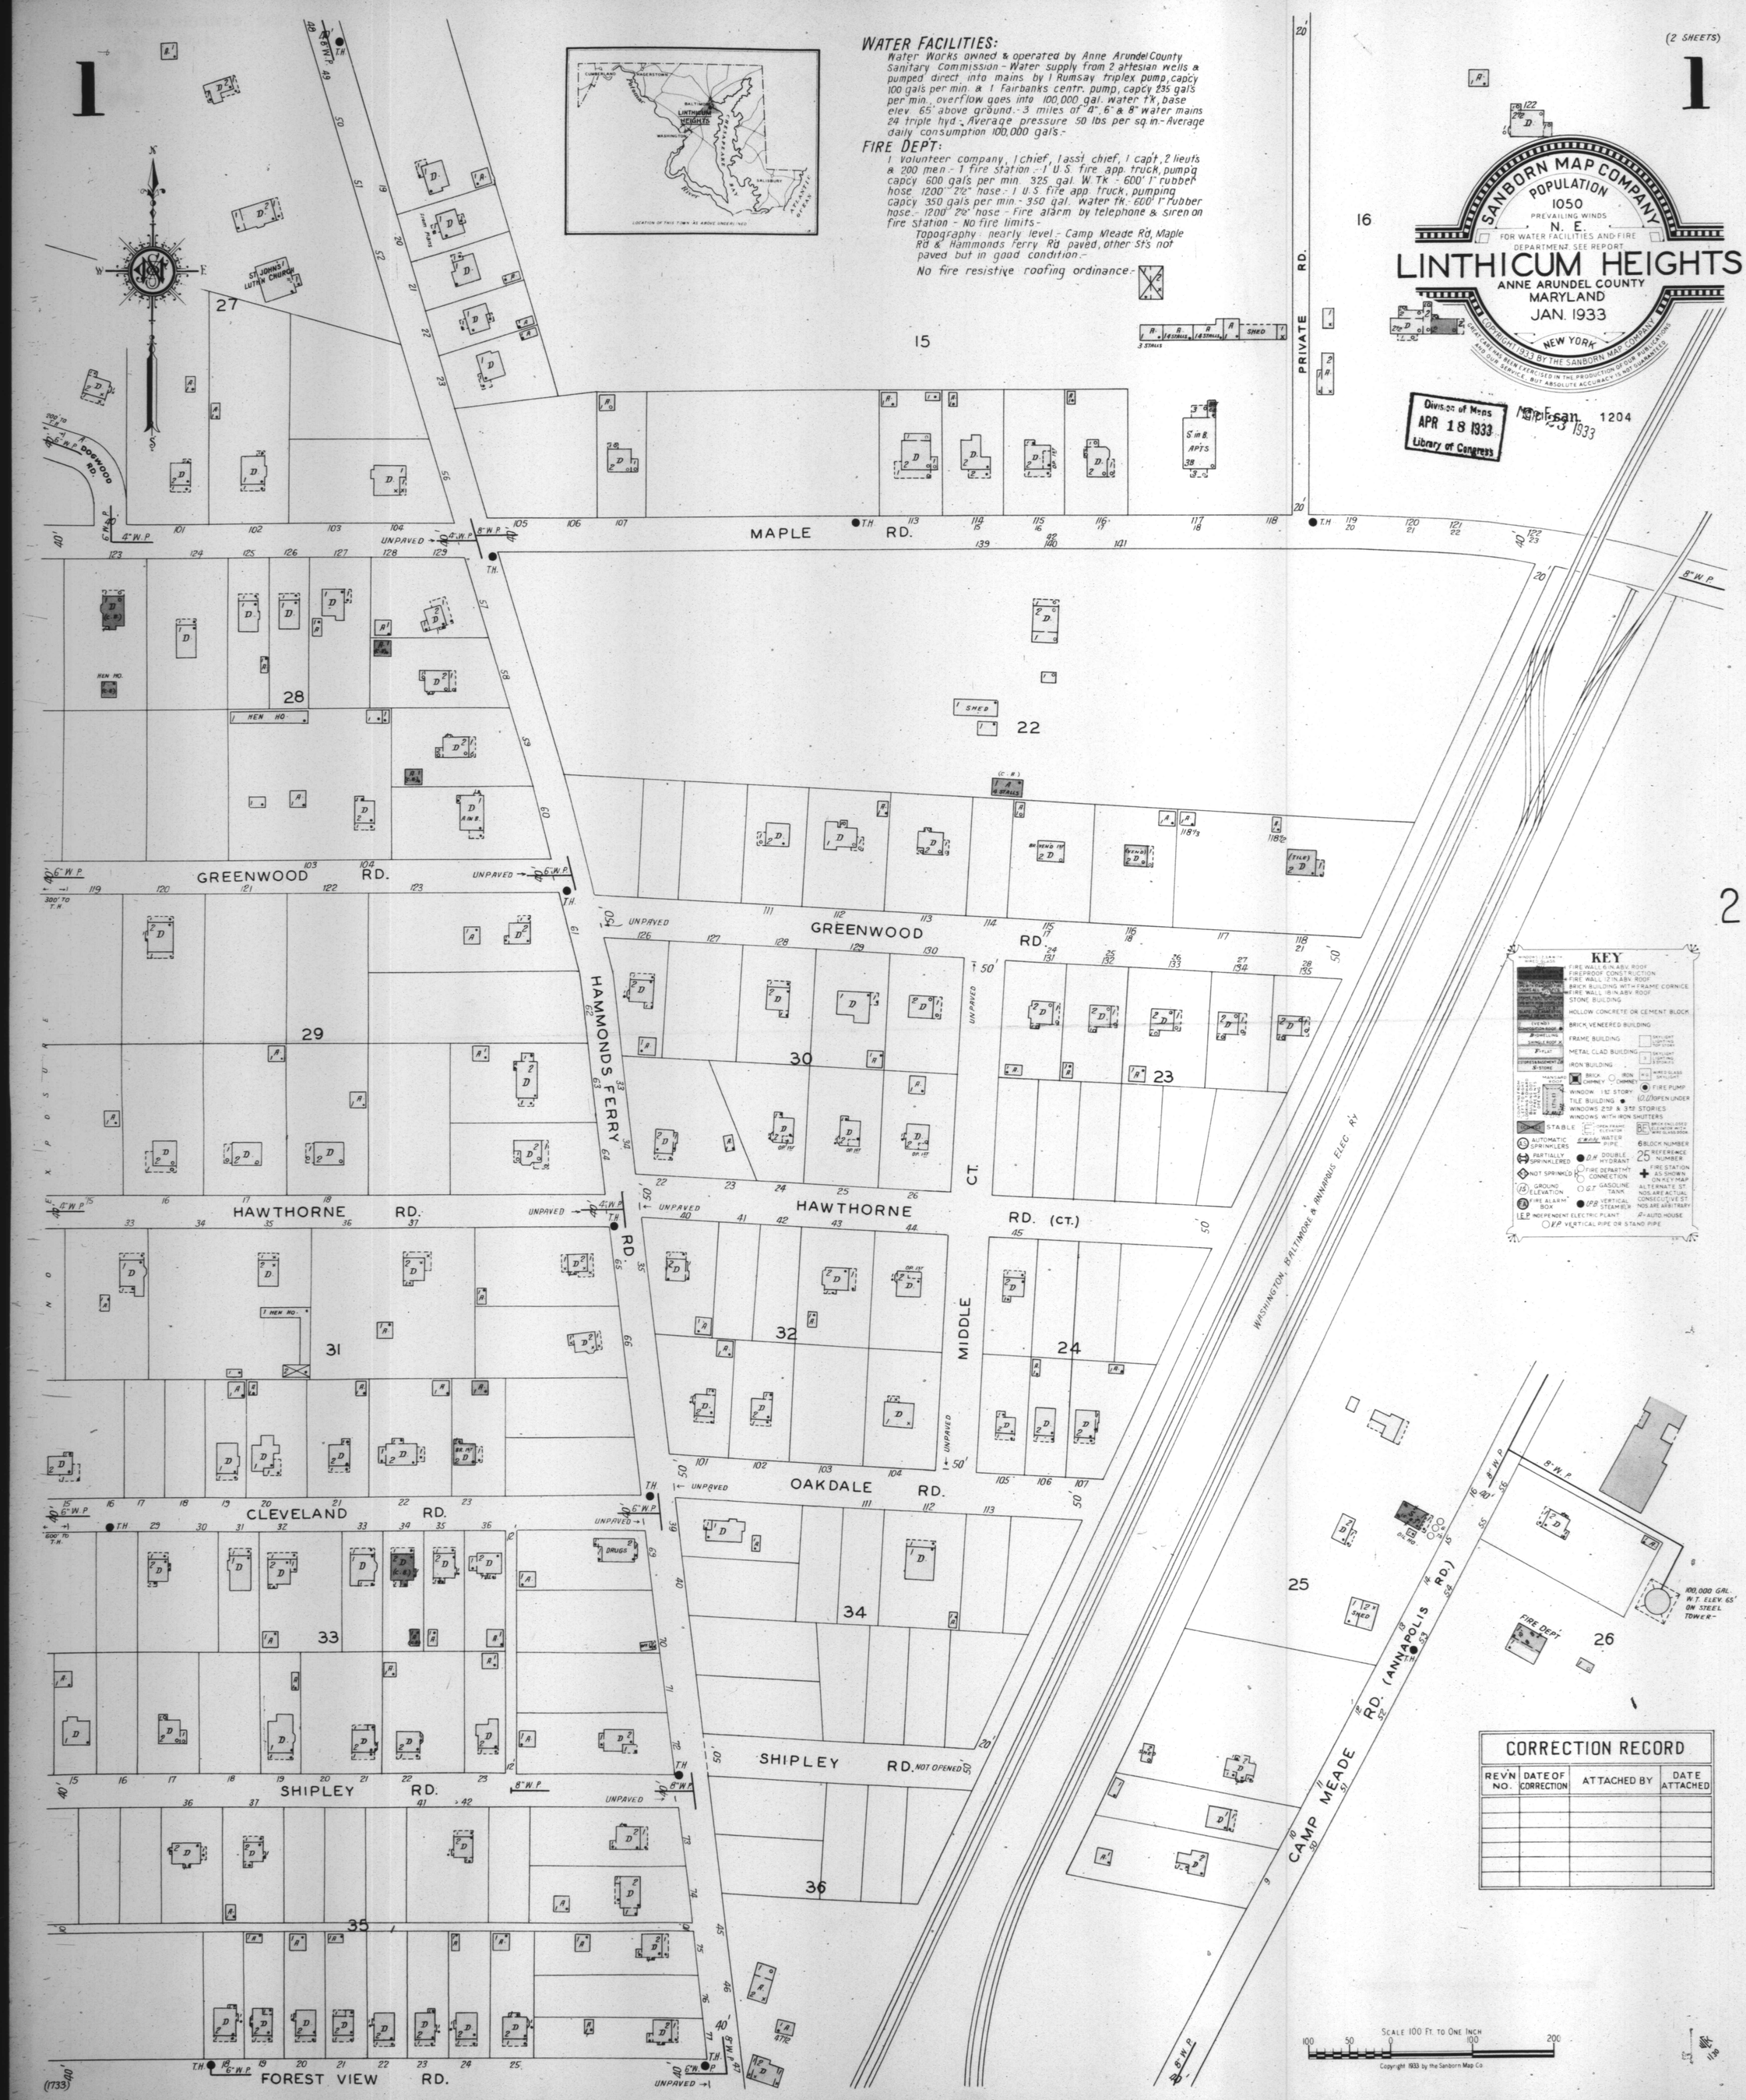
No fire resistive roofing ordinance. -