MD....505

(2 SHEETS)

29 1

WATER FACILITIES:

Water Works owned & operated by Anne Arundel County Sanitary Commission.- Water supply from 2 artesian wells & pumped direct into mains by 1 Rumsay triplex pump, capcy 100 gals per min. & 1 Fairbanks centr. pump, capcy 235 gals per min., overflow goes into 100,000 gal. water tk, base elev. 65' above ground.- 3 miles of 4", 6" & 8" water mains 24 triple hyd.- Average pressure 50 lbs per sq in.- Average daily consumption 100,000 gals.-

FIRE DEPT:

1 Volunteer company, 1 chief, 1 asst chief, 1 capt, 2 lieuts & 200 men.- 1 fire station.- 1 U.S. fire app. truck, pumpg capcy 600 gals per min. 325 gal. W. Tk.- 600' 1" rubber hose 1200'- 2½" hose.- 1 U.S. fire app. truck, pumping capcy 350 gals per min.- 350 gal. water tk.- 600' 1" rubber hose.- 1200' 2½" hose.- Fire alarm by telephone & siren on fire station.- No fire limits.-

Topography: nearly level.- Camp Meade Rd, Maple Rd & Hammonds Ferry Rd paved, other St's not paved but in good condition.-

No fire resistive roofing ordinance.-

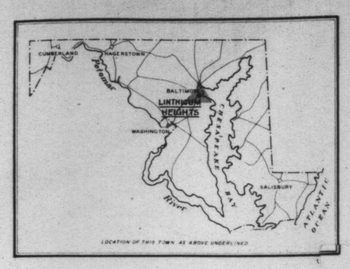

SANBORN MAP COMPANY

POPULATION 2000

PREVAILING WINDS N. E.

FOR WATER FACILITIES AND FIRE DEPARTMENT, SEE REPORT

LINTHICUM HEIGHTS

ANNE ARUNDEL COUNTY
MARYLAND
JAN. 1933

NEW YORK

COPYRIGHT 1933 BY THE SANBORN MAP COMPANY
GREAT CARE HAS BEEN EXERCISED IN THE PRODUCTION OF OUR PUBLICATIONS AND OUR SERVICE BUT ABSOLUTE ACCURACY IS NOT GUARANTEED

ALL RIGHTS RESERVED. NO PART OF THIS MAP MAY BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION FROM THE SANBORN MAP COMPANY.

KEY

FIRE WALL 6 IN. ABV. ROOF
FIREPROOF CONSTRUCTION
FIRE WALL 12 IN. ABV. ROOF
BRICK BUILDING WITH FRAME CORNICE
FIRE WALL 18 IN. ABV. ROOF
STONE BUILDING
HOLLOW CONCRETE OR CEMENT BLOCK
BRICK VENEERED BUILDING
FRAME BUILDING
METAL CLAD BUILDING
IRON BUILDING
BRICK CHIMNEY
IRON CHIMNEY
FIRE PUMP
WINDOW 1½ STORY
TILE BUILDING
WINDOWS 2½ & 3½ STORIES
WINDOWS WITH IRON SHUTTERS
STABLE
WATER PIPE
AUTOMATIC SPRINKLERS
PARTIALLY SPRINKLERED
NOT SPRINKLED
GROUND ELEVATION
FIRE ALARM BOX
INDEPENDENT ELECTRIC PLANT
DOUBLE HYDRANT
FIRE DEPARTMT CONNECTION
GASOLINE TANK
VERTICAL STEAM BLR
VERTICAL PIPE OR STAND PIPE
BLOCK NUMBER
REFERENCE NUMBER
FIRE STATION AS SHOWN ON KEY MAP
ALTERNATE ST NOS. ARE ACTUAL CONSECUTIVE ST NOS. ARE ARBITRARY
A - AUTO HOUSE

CORRECTION RECORD

REV'N NO.	DATE OF CORRECTION	ATTACHED BY	DATE ATTACHED
1	12/43	J.L.F.	7/41/4

SCALE 100 FT. TO ONE INCH

Copyright 1933 by the Sanborn Map Co.

2

11