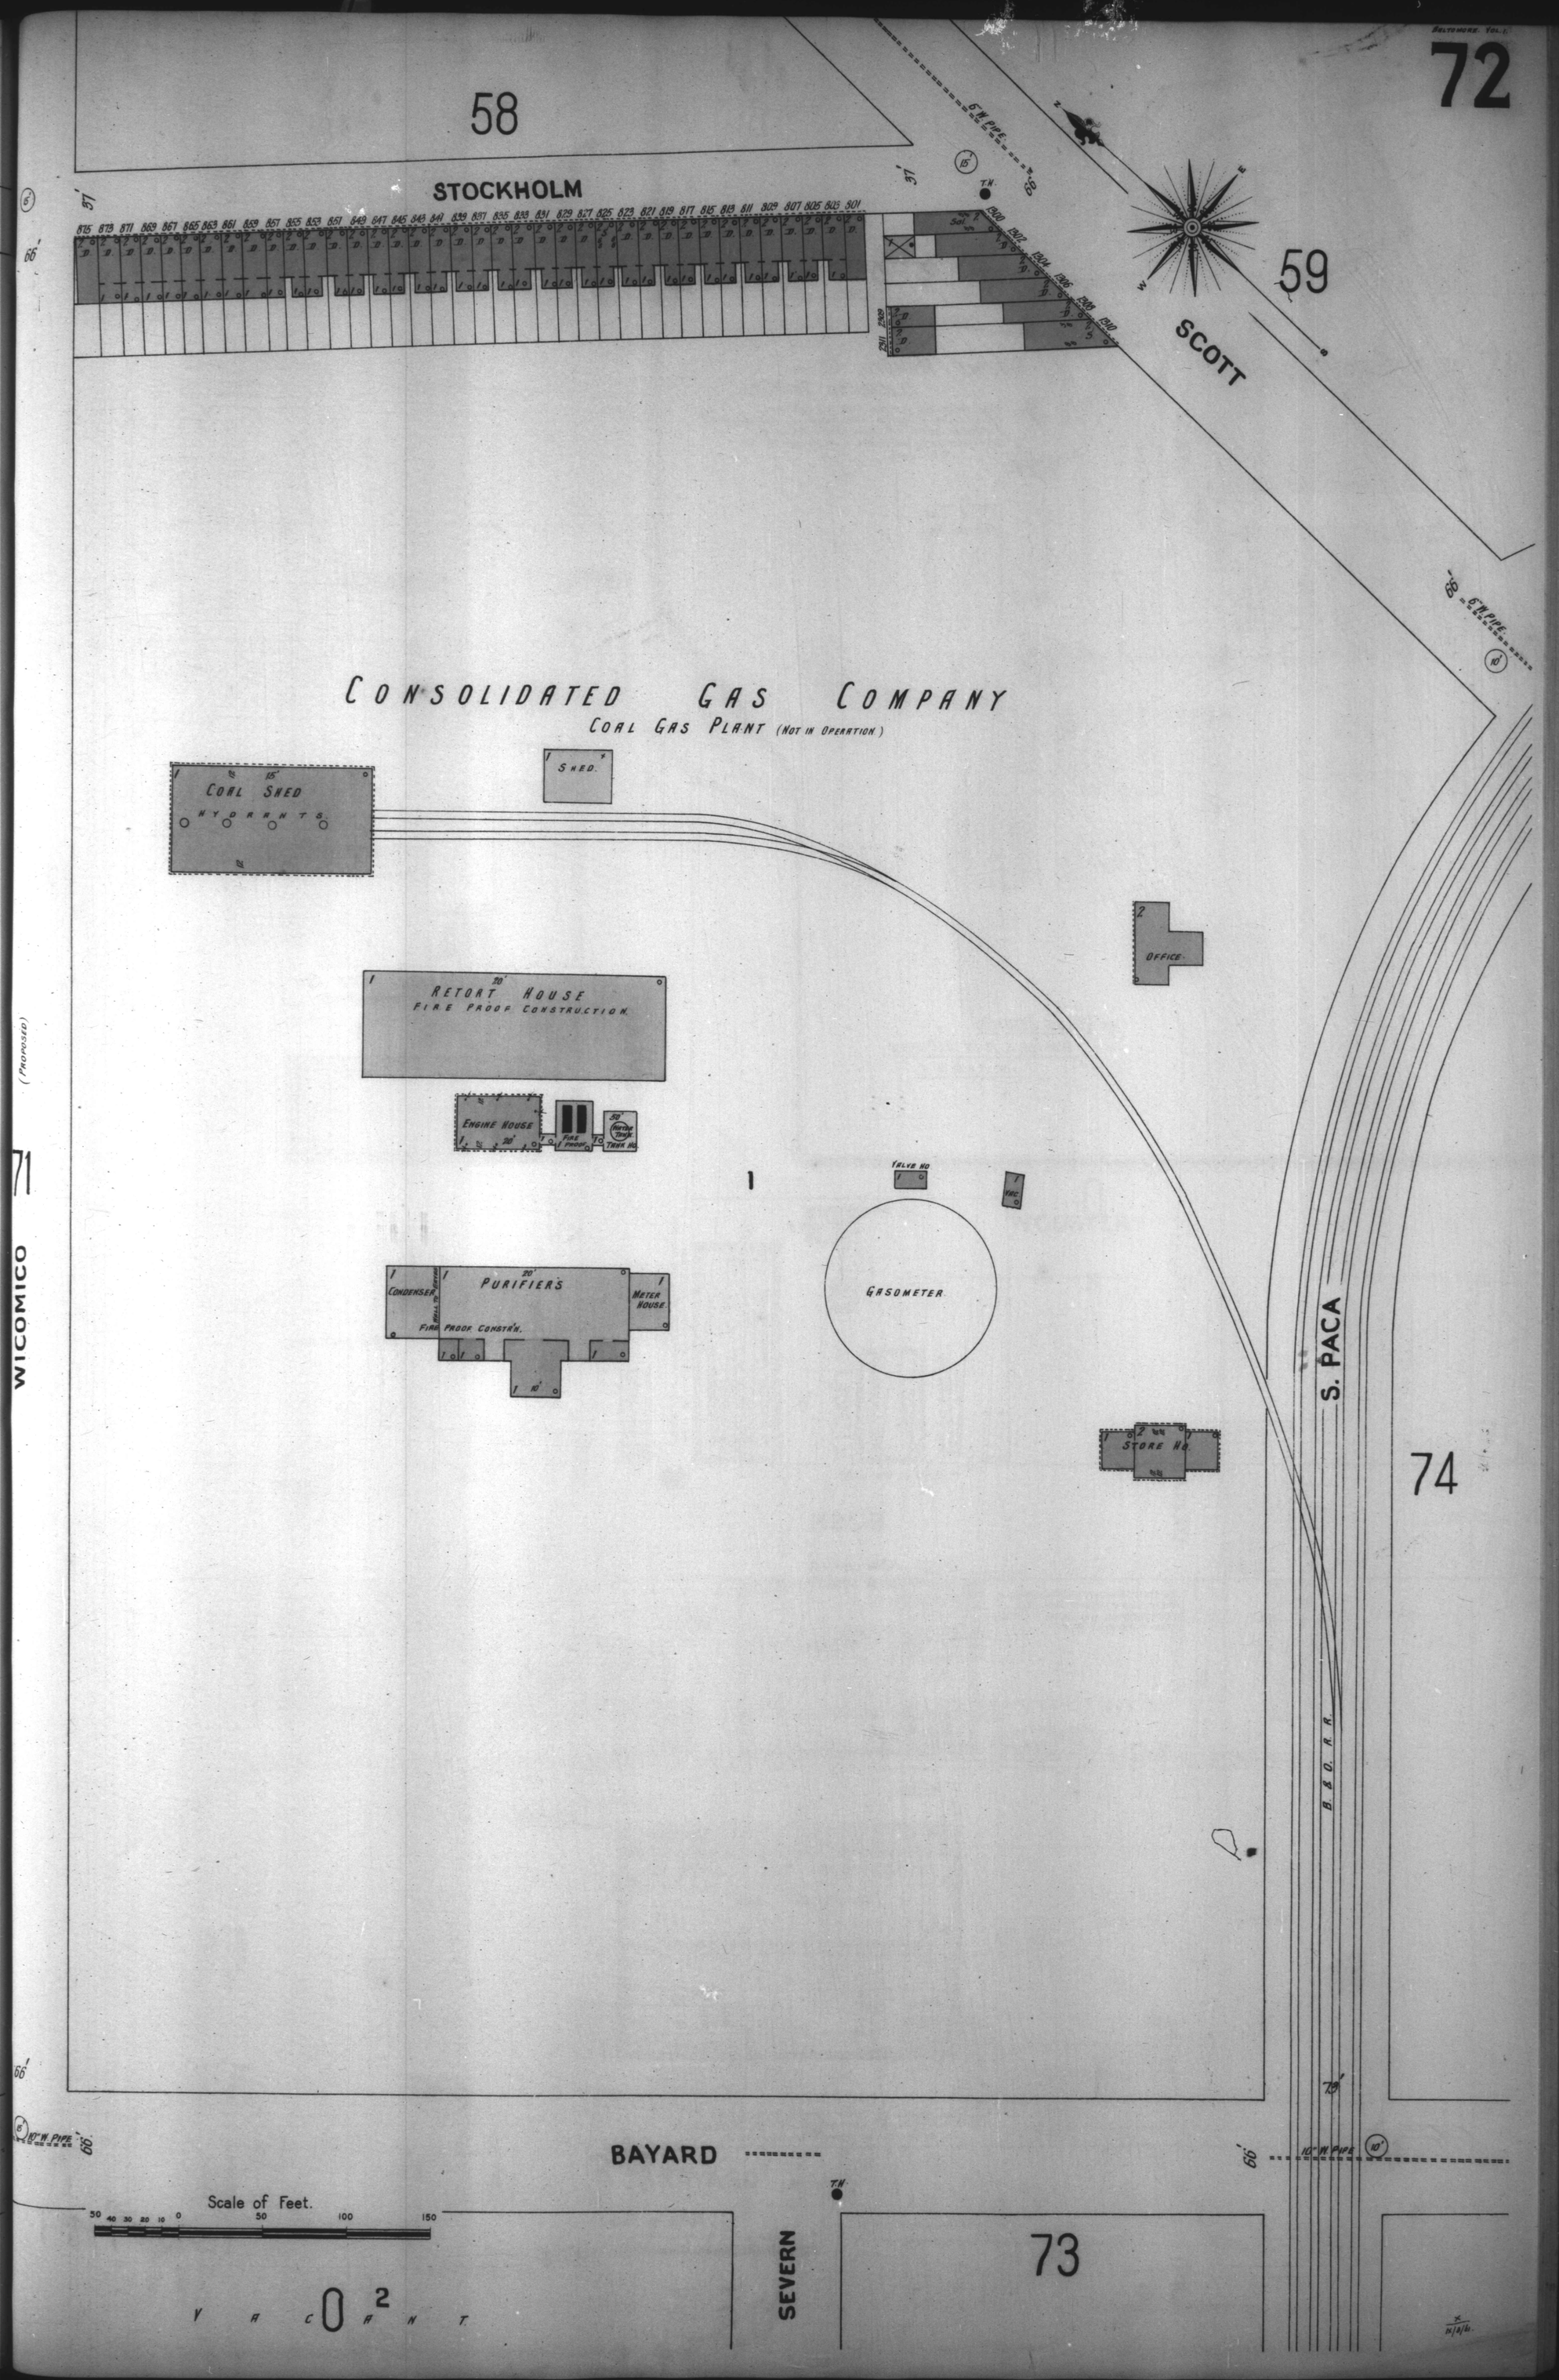
BALTIMORE. VOL. I.
72
58
STOCKHOLM
59
SCOTT
6" W. PIPE
CONSOLIDATED GAS COMPANY
COAL GAS PLANT (NOT IN OPERATION)
COAL SHED
HYDRANTS
SHED
OFFICE
RETORT HOUSE
FIRE PROOF CONSTRUCTION
ENGINE HOUSE
FIRE PROOF
50' WATER TANK
TANK HO.
VALVE HO.
VAC.
GASOMETER
CONDENSER
PURIFIERS
FIRE PROOF CONSTR'N.
METER HOUSE
STORE HO.
S. PACA
B. & O. R. R.
74
71
72
WICOMICO
(PROPOSED)
10" W. PIPE
BAYARD
SEVERN
73
Scale of Feet.
50 40 30 20 10 0 50 100 150
VACANT