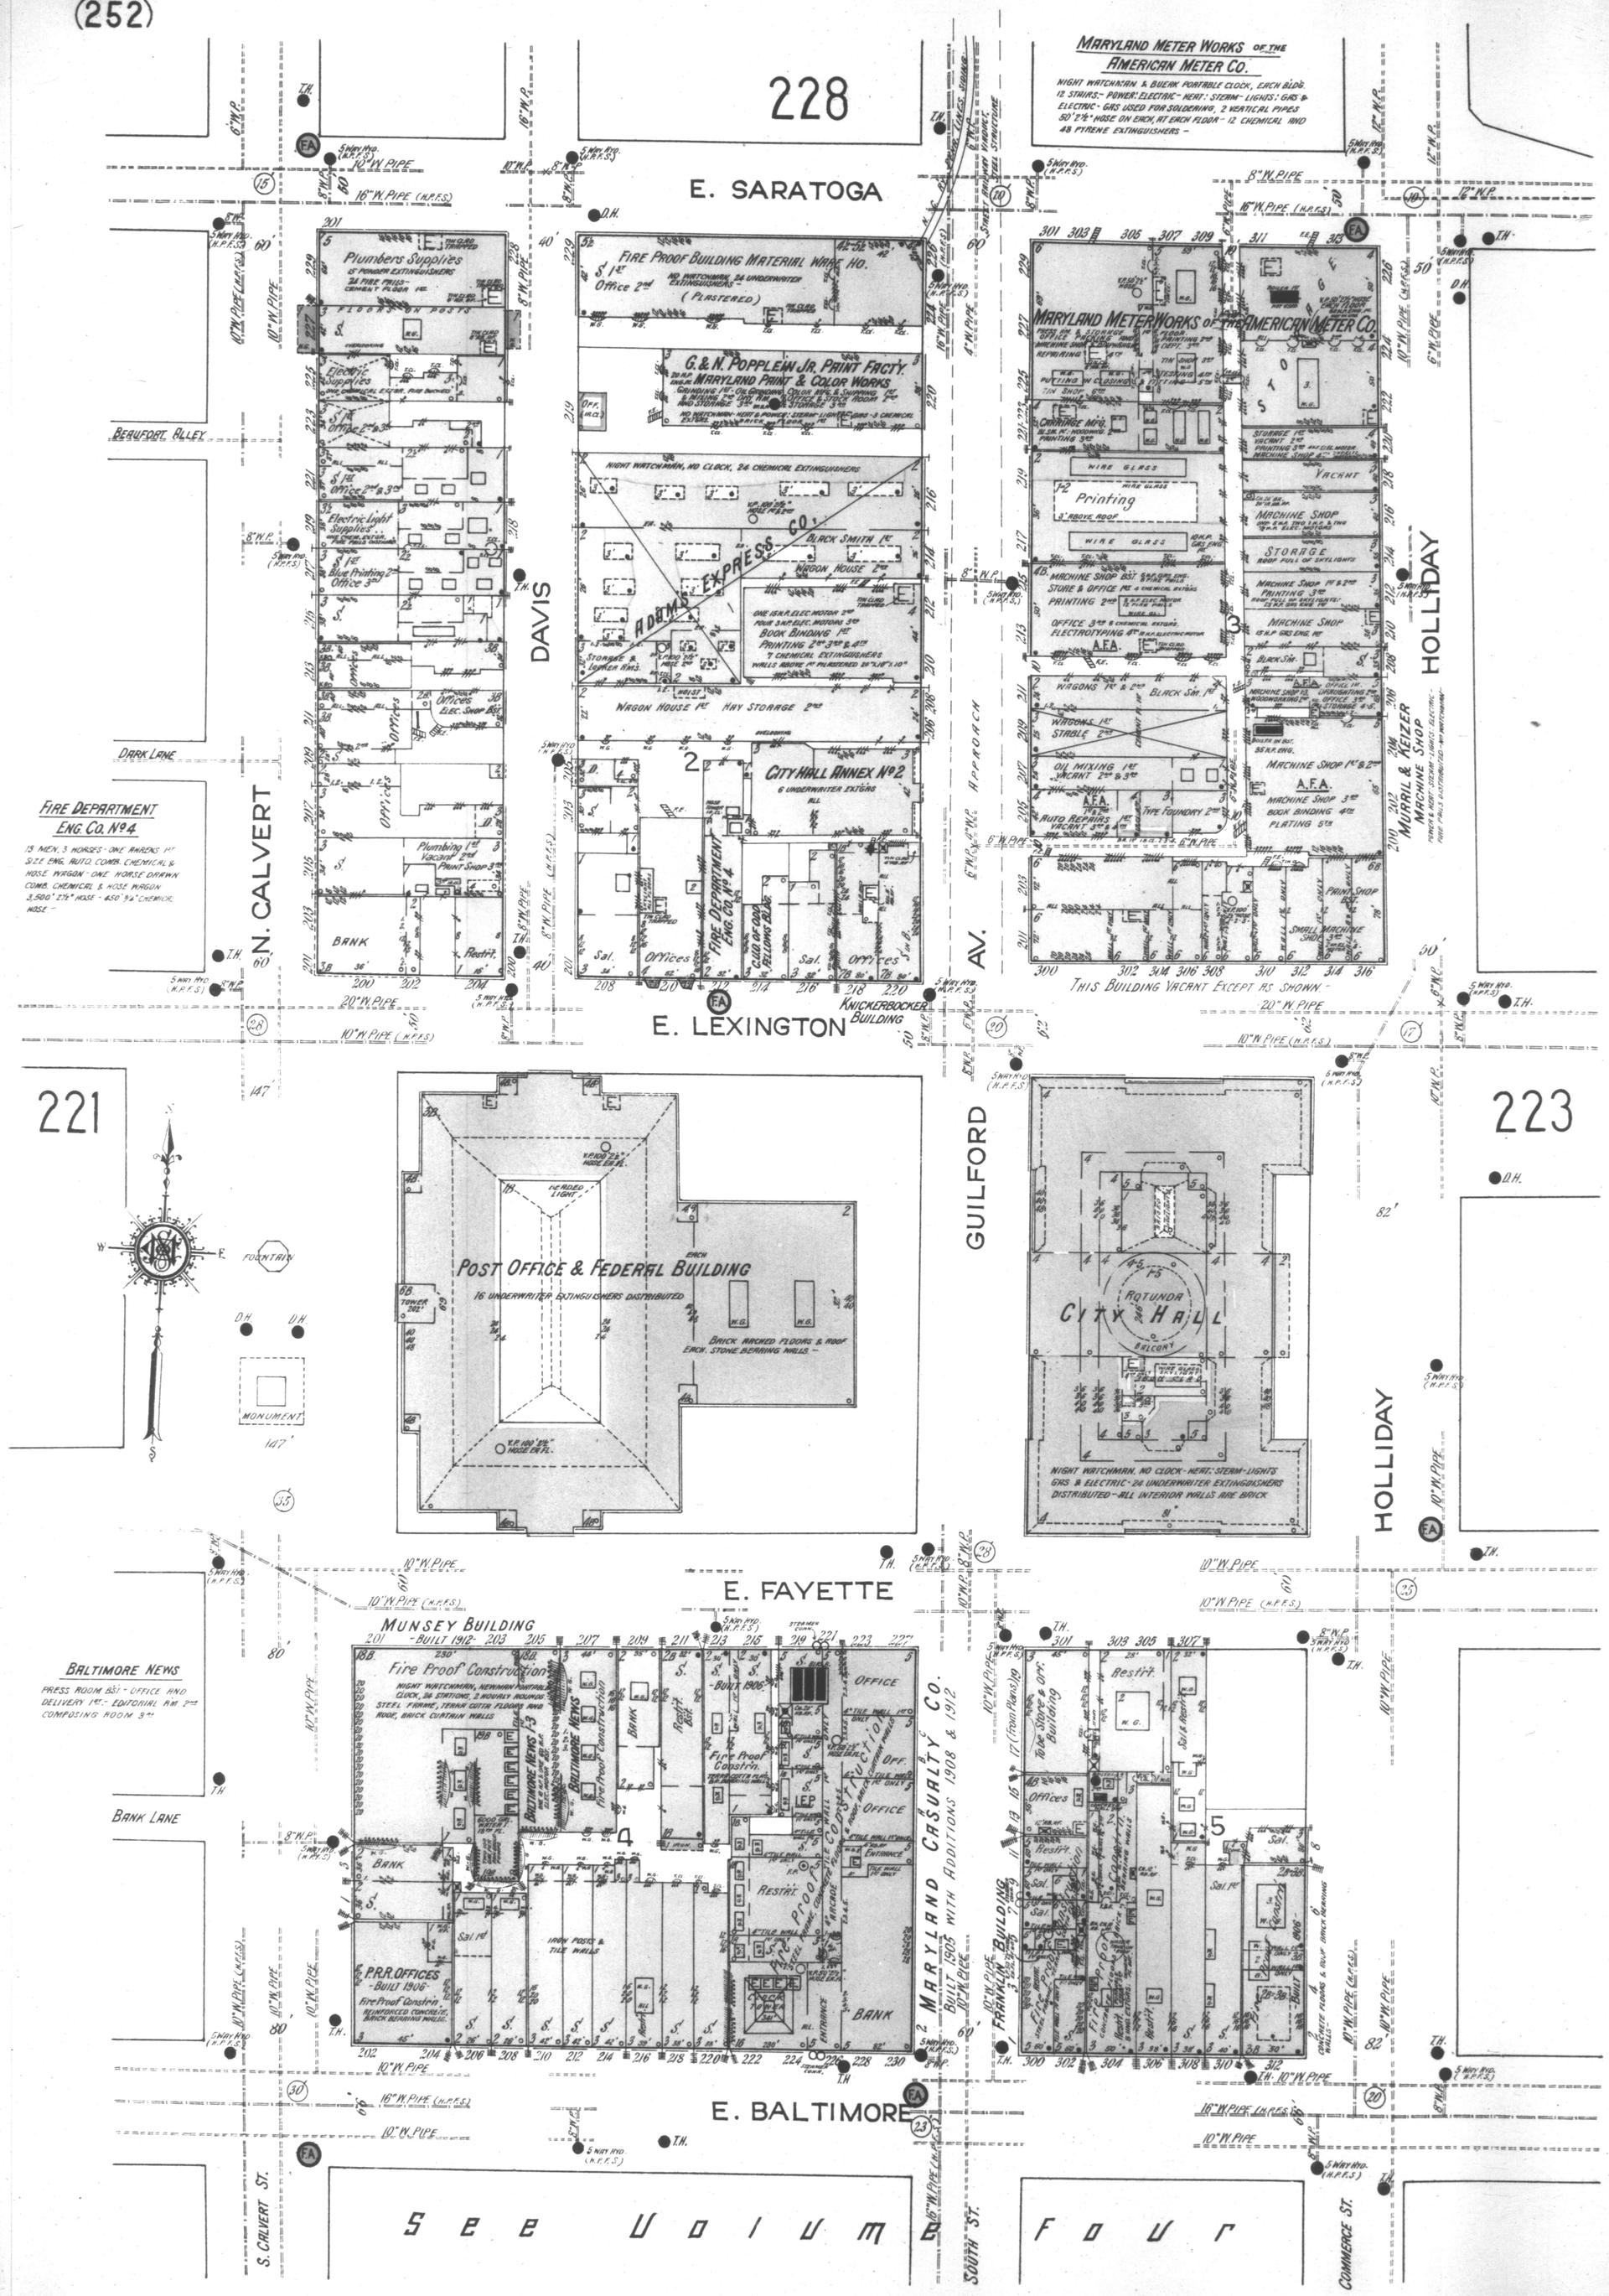

MARYLAND CASUALTY BLDG.

NIGHT WATCHMAN, POWER AND HEAT: STEAM - FUEL: COAL LIGHTS: ELECTRIC I.E.P. ONE 125, ONE 50 & ONE 35 K.W. GENERATOR. VERTICAL PIPES AND HOSE AS SHOWN - UNDERWRITER STANDARD DUPLEX F.P. 750 GALS. PER MIN. FIRE PROOF CONSTRUCTION:- EAST PART OF BUILDING BUILT 1908 - WEST PART OF BUILDING & TOWER BUILT 1912