(3105)
(4 SHEETS)

1

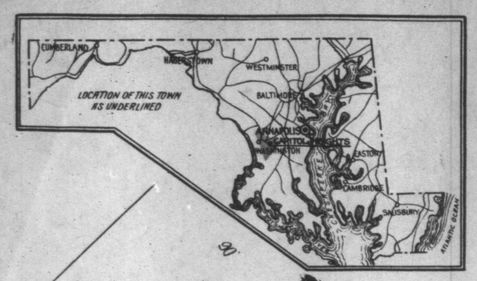

INDEX

SPECIALS

	SHEET
C	
Capitol Heights Public School,	2
C. B. R. R. Depot, at Seat Pleasant,	3
Congregational Church,	2
F	
Fire Department,	2
" " at Seat Pleasant,	3
First Baptist Church,	2
I	
I. O. O. F. Hall,	1
P	
Post Office, at Seat Pleasant,	3
S	
St. Mathias' Roman Catholic Church,	2
Seat Pleasant Public School,	3
T	
Town Hall,	2

KEY

WINDOWS LIS WITH WIRE GLASS
FIRE WALL 6 IN ABV ROOF
METAL CORNICE
FIRE WALL 12 IN ABV ROOF
WOOD CORNICE
FIRE WALL 18 IN ABV ROOF
FRAME PARTITION
OPENING WITH IRON DOOR
" " "STANDARD" IRON DOOR
WINDOWS & IRON SHUTTERS
WINDOWS 1st STORY
WINDOWS 1st & 3rd STORIES
" 2nd & 4th "
STABLE (CB) - CONCRETE BLOCK
BUILDINGS COLORED YELLOW ARE FRAME
" " RED BRICK
" " BLUE STONE
" " GRAY IRON
" " BROWN FIRE PROOF
INDICATE RELATIVE HEIGHTS
AUTOMATIC SPRINKLERS
FIRE STATION, AS SHOWN ON KEY MAP
ALTERNATE STREET NUMBERS ARE ACTUAL
CONSECUTIVE STREET NOS ARE ARBITRARY

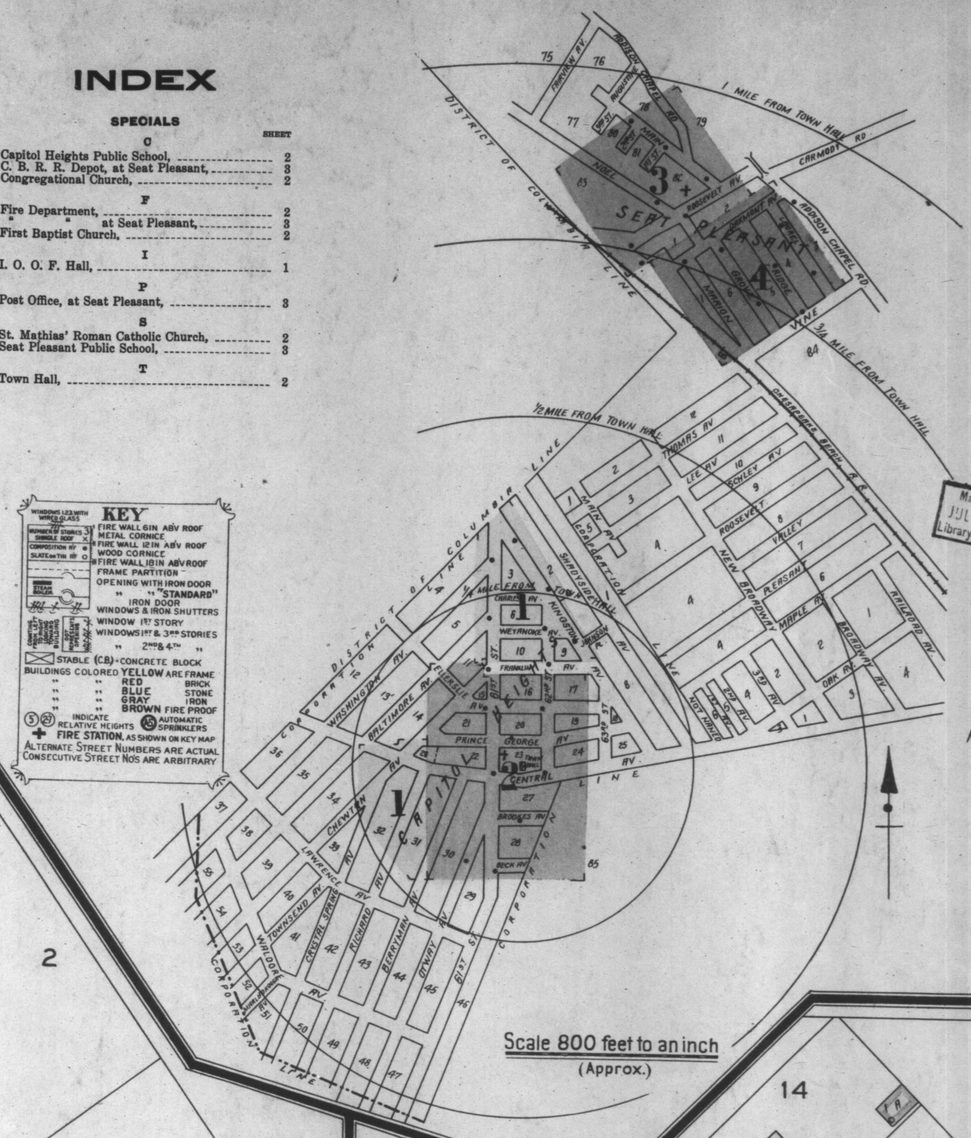

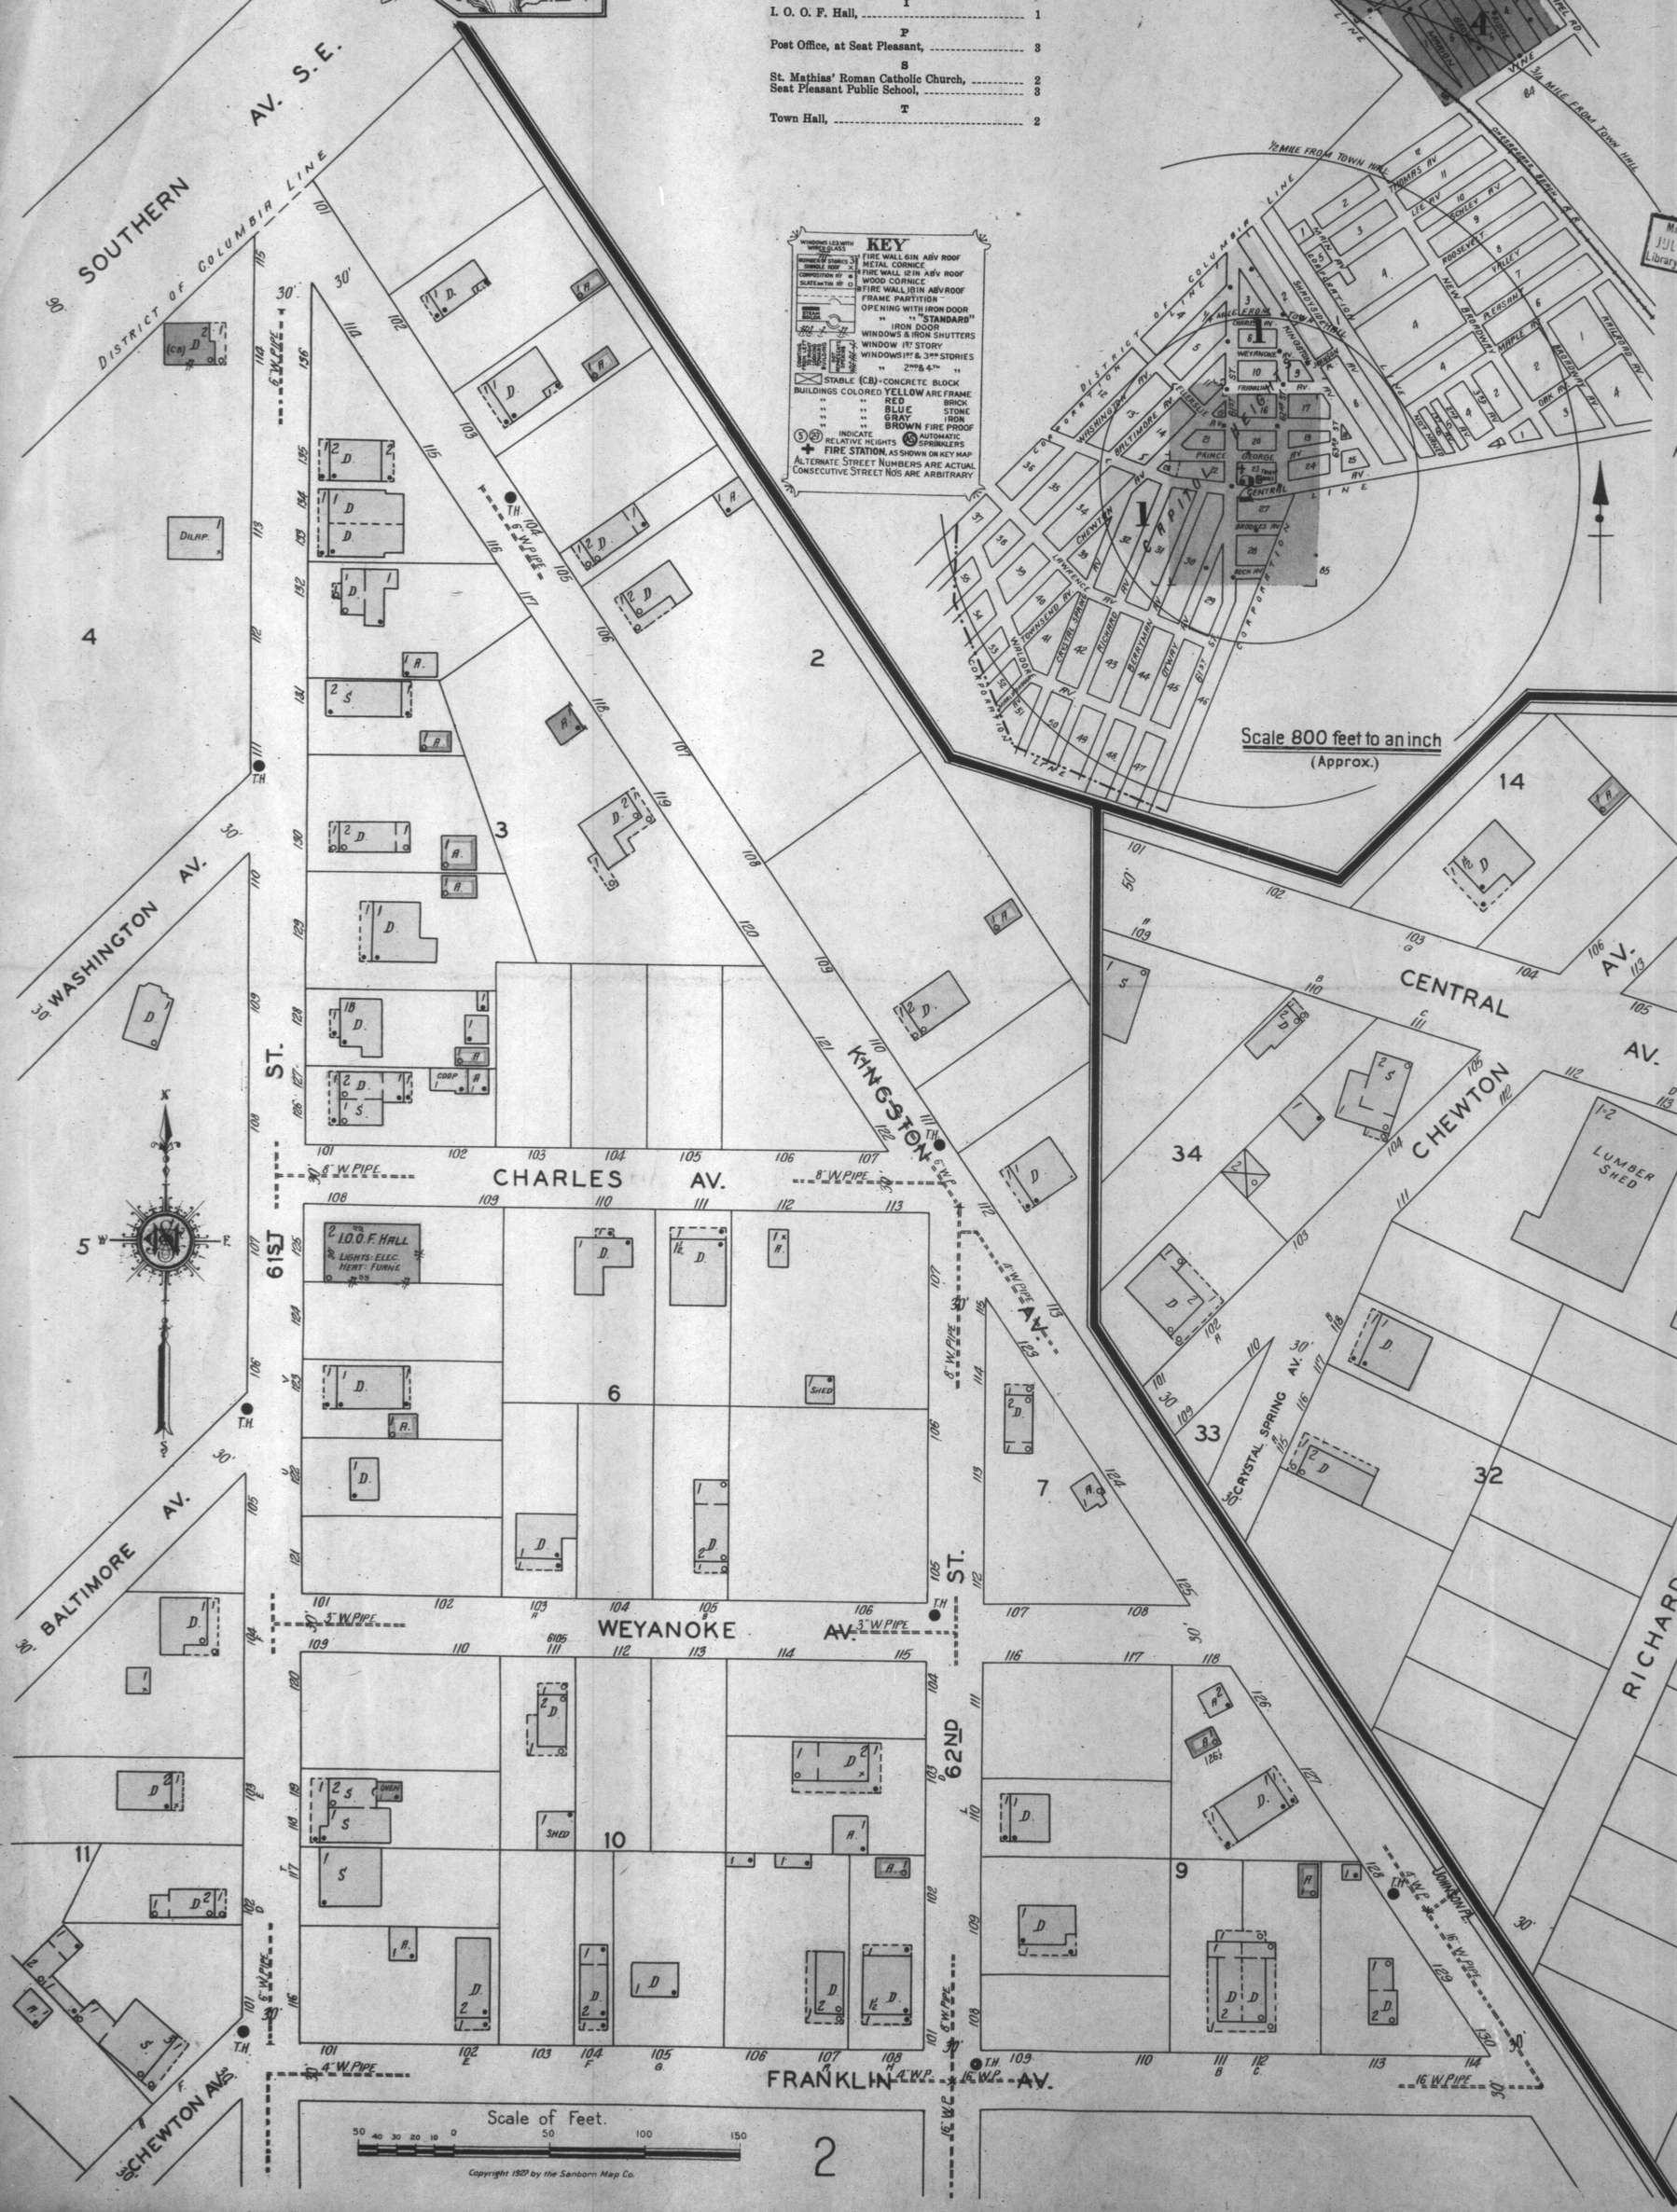

Map Division
JUL 28 1927
Library of Congress

SANBORN MAP COMPANY
POPULATION 4000
PREVAILING WINDS WEST
FOR WATER FACILITIES AND FIRE DEPARTMENT, SEE REPORT.

CAPITOL HEIGHTS

PRINCE GEORGES COUNTY
MARYLAND
APRIL 1927
NEW YORK

COPYRIGHT 1927 BY THE SANBORN MAP COMPANY.
GREAT CARE HAS BEEN EXERCISED IN THE PRODUCTION OF OUR PUBLICATIONS AND OUR SERVICE, BUT ABSOLUTE ACCURACY IS NOT GUARANTEED
©aP 46231 JUL 13 '27

INCLUDING SEAT PLEASANT

WATER FACILITIES

Pumping system of water works owned by Washington Suburban Sanitary Commission. Water supply from N W Branch Potomac River at Burnt Mills Md., located 10 miles N W of Town Hall. Water is pumped direct into mains by 3 high lift De Laval elec. pumps, combined capy 2800 g.p.m. & 2 low lift De Laval elec pumps combined capy 2600 g.p.m. 30 ft.hs. 3 miles of 3" to 16 water mains. Domestic & fire pressure 50 lbs per sq inch. Average daily consumption 200,000 gals

FIRE DEPT:

CAPITOL HEIGHTS: Volunteer Co. 1-chief, 20 men 1-Fire Station. 1-Studebaker triple combination 500 g.p.m capy. 40 gal chem tank, 100 chem hose. 1000' 2½" hose 1 Ford chem truck 60 gal chem tank 90' chem hose

SEAT PLEASANT: Volunteer Co. 1-chief, 15 men. 1-Fire Station. 1-Reo triple combination capy 500 g.p.m 40 gal. chem tank. 100' chem hose. 1000' 2½" hose. 1-Ford chem truck 60 gal chem tank 100' chem hose. All apparatus motorized. Fire alarms by sirens on Fire Stations. Capitol Heights - iron clad bldg, Seat Pleasant - brick bldg No Fire Limits

Grades nearly level. Central Av. & 61st St paved. Others gravel piked. Public lights - electric.

2