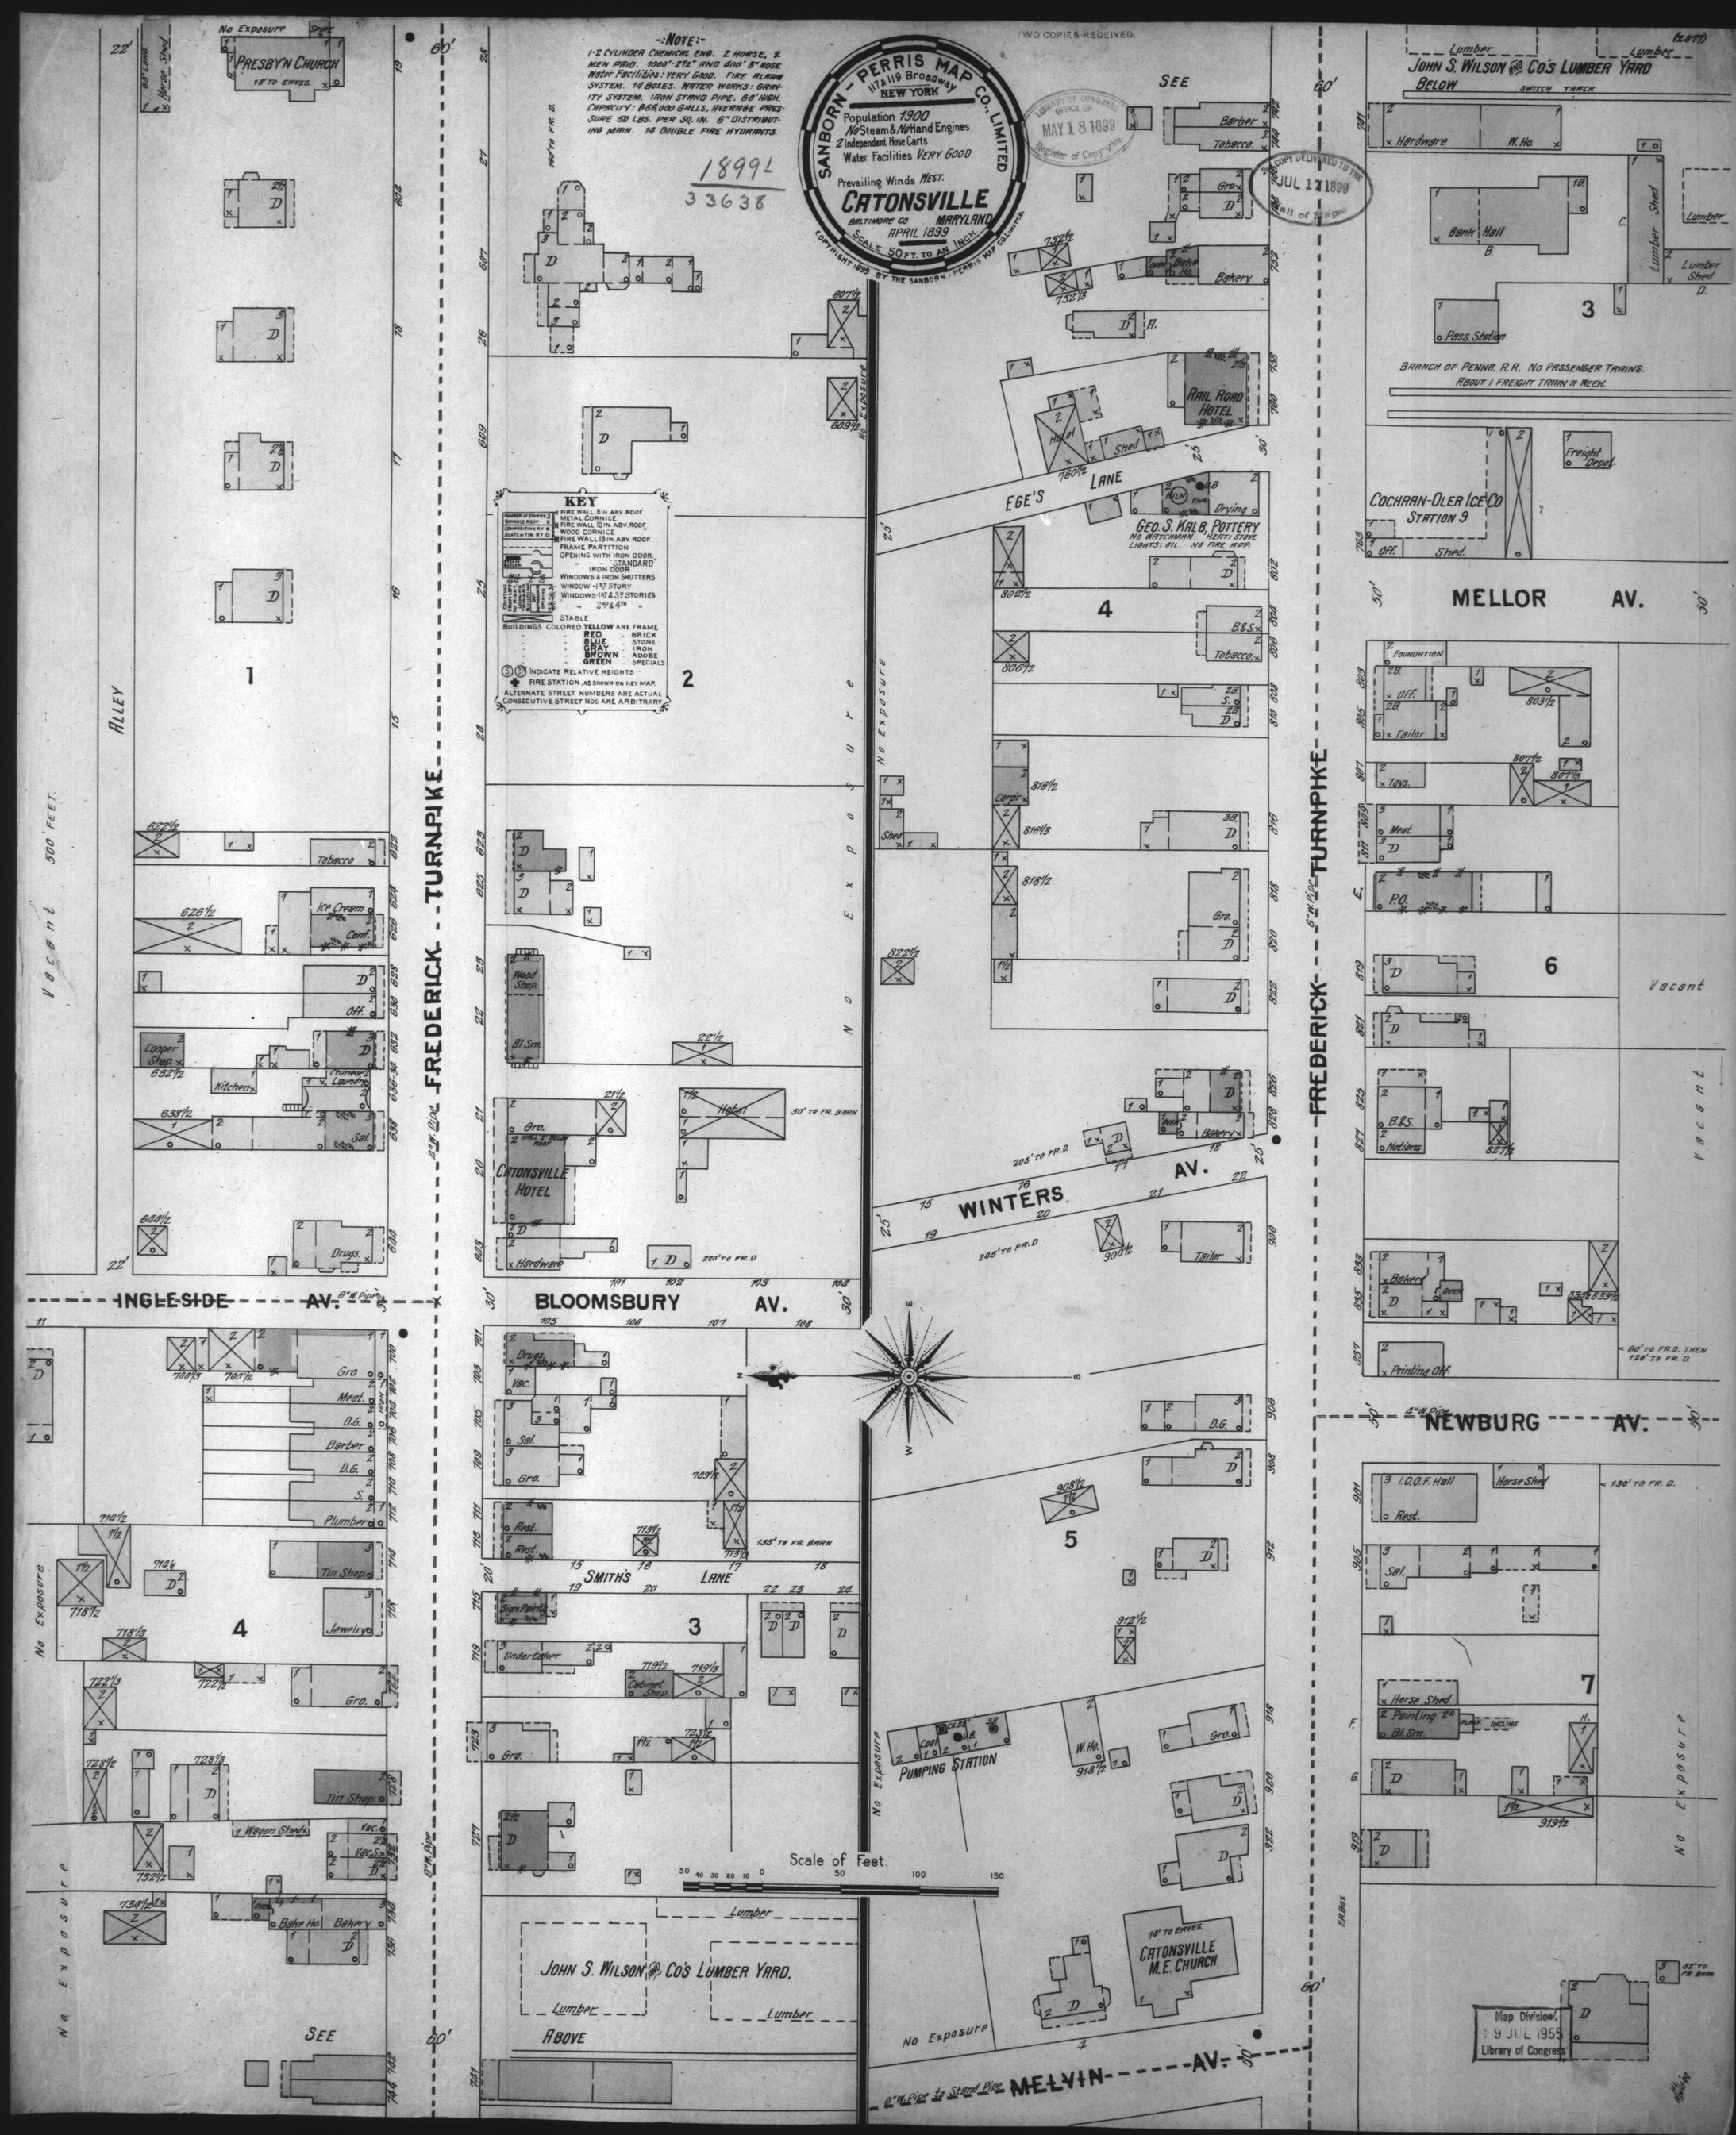
SANBORN-PERRIS MAP CO. LIMITED
117 & 119 Broadway
NEW YORK
Population 1900
No Steam & No Hand Engines
2 Independent Hose Carts
Water Facilities VERY GOOD
Prevailing Winds WEST.
CATONSVILLE
BALTIMORE CO. MARYLAND
APRIL 1899
SCALE 50 FT. TO AN INCH.
COPYRIGHT 1899 BY THE SANBORN-PERRIS MAP CO. LIMITED.
TWO COPIES RECEIVED.
1899
33638
-:NOTE:-
1-2 CYLINDER CHEMICAL ENG. 2 HORSE, 2 MEN PRID. 1000'-2½" AND 400' 3" HOSE. Water Facilities: VERY GOOD. FIRE ALARM SYSTEM. 14 BOXES. WATER WORKS: GRAVITY SYSTEM. IRON STAND PIPE. 60' HIGH. CAPACITY: 856,000 GALLS, AVERAGE PRESSURE 50 LBS. PER SQ. IN. 6" DISTRIBUTING MAIN. 14 DOUBLE FIRE HYDRANTS.
KEY
FIRE WALL 8 IN. ABV. ROOF, METAL CORNICE
FIRE WALL 12 IN. ABV. ROOF, WOOD CORNICE
FIRE WALL 18 IN. ABV. ROOF
FRAME PARTITION
OPENING WITH IRON DOOR
" " STANDARD IRON DOOR
WINDOWS & IRON SHUTTERS
WINDOW - 1ST STORY
WINDOWS - 1ST & 3RD STORIES
" 2ND & 4TH "
STABLE
BUILDINGS COLORED YELLOW ARE FRAME, RED BRICK, BLUE STONE, GRAY IRON, BROWN ADOBE, GREEN SPECIALS
INDICATE RELATIVE HEIGHTS
FIRE STATION, AS SHOWN ON KEY MAP.
ALTERNATE STREET NUMBERS ARE ACTUAL CONSECUTIVE STREET NOS. ARE ARBITRARY.
LIBRARY OF CONGRESS OFFICE OF MAY 18 1899 Register of Copyrights
COPY DELIVERED TO THE JUL 17 1899 Hall of Records
PRESBY'N CHURCH
14' TO EAVES
ALLEY
500' FEET
Vacant
FREDERICK TURNPIKE
INGLESIDE AV.
BLOOMSBURY AV.
WINTERS AV.
MELLOR AV.
NEWBURG AV.
MELVIN AV.
EGE'S LANE
SMITH'S LANE
RAIL ROAD HOTEL
GEO. S. KALB POTTERY
NO WATCHMAN. HEAT: STOVE. LIGHTS: OIL. NO FIRE APP.
CATONSVILLE HOTEL
JOHN S. WILSON AND CO'S LUMBER YARD
BELOW
ABOVE
BRANCH OF PENNA. R.R. NO PASSENGER TRAINS.
ABOUT 1 FREIGHT TRAIN A WEEK.
COCHRAN-OLER ICE CO. STATION 9
PUMPING STATION
CATONSVILLE M.E. CHURCH
14' TO EAVES
No Exposure
SEE
Scale of Feet.
Map Division
19 JUL 1955
Library of Congress